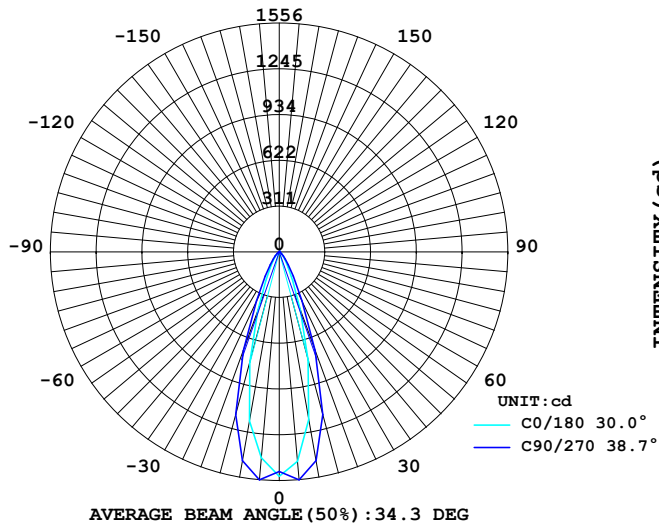
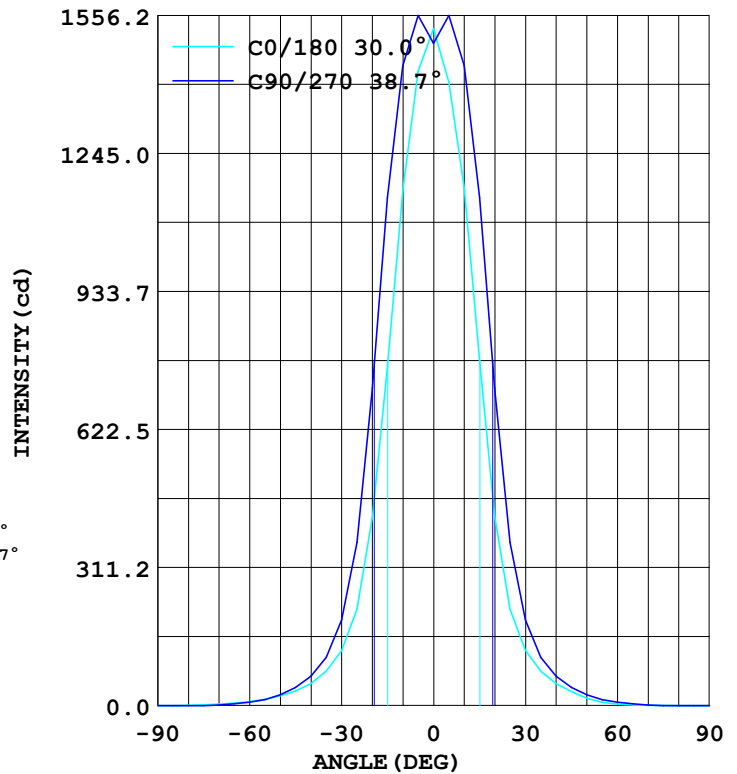


LUMINAIRE PHOTOMETRIC TEST REPORT

Report number:

MANUFACTURER:		
Address:		
NAME: FT100 8W 30D	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

DATA OF LAMP		Imax(cd)	1556	S/MH (C0/180)	0.50
MODEL		EFFICIENCY (%)	100.0	S/MH (C90/270)	0.60
NOMINAL POWER(W)	8	TOTAL FLUX(lm)	652.37	Voltage(V)	230.2
RATED VOLTAGE (V)	230	EFFICIENCY (lm/W)	77.7	Current(A)	0.067
NOMINAL FLUX(lm)	652.4	η up (%)	0.2	Power(W)	8.400
LAMPS QUANTITY	1	η down (%)	99.8	Power Factor (PF)	0.545
TEST VOLTAGE (V)	230.3	Effective Flux(lm)	543.2	EEI	0.000 (E)

LUMINOUS INTENSITY DISTRIBUTION

LUMINOUS INTENSITY DISTRIBUTION


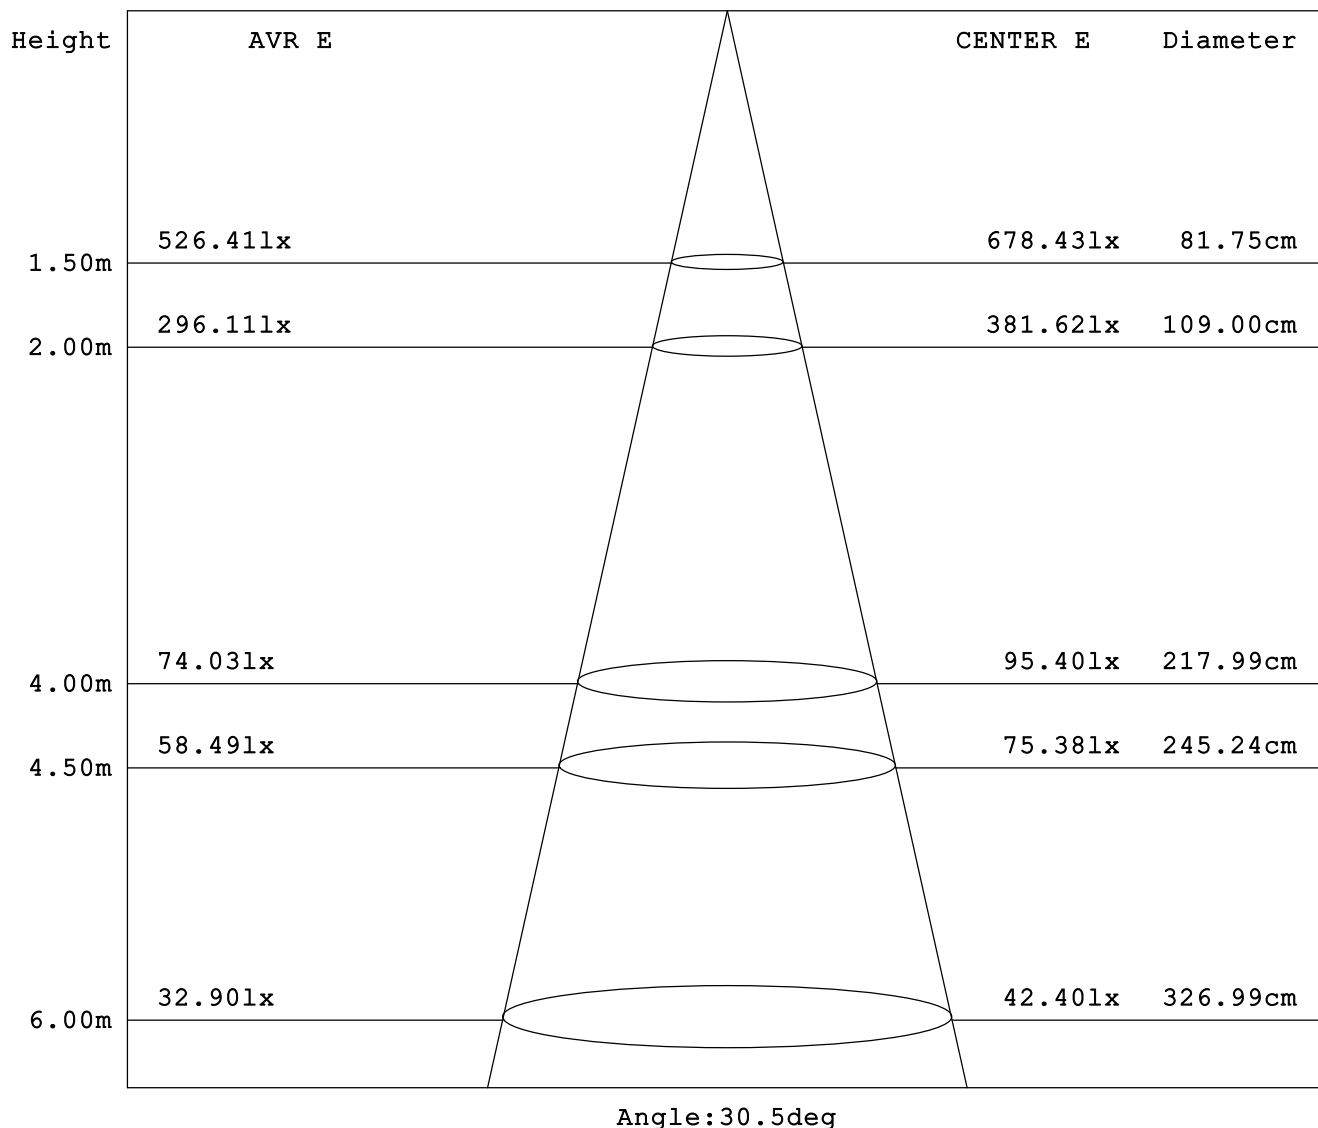
Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:06-29-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

AVERAGE AND CENTER E Figure

Report number:

MANUFACTURER:		
Address:		
NAME: FT100 8W 30D	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:



Test System: HopooColor HPG1800
 Temperature: 25.3DEG
 Operators:
 Test Date: 06-29-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity: 65.0%
 Test Distance: 8.300 m
 Remarks:

ZONAL FLUX DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: FT100 8W 30D	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

γ	C0	C90	C180	C270					γ	Zone	total
10.0	1160	1442	1168	1442					0- 10	135.4	135.4
20.0	423.8	714.8	427.3	714.8					10- 20	260.0	395.5
30.0	124.0	192.9	124.2	192.9					20- 30	147.5	543.1
40.0	49.73	65.85	49.11	65.85					30- 40	62.22	605.3
50.0	22.11	23.90	16.39	23.90					40- 50	29.05	634.4
60.0	9.231	7.233	3.375	7.233					50- 60	11.81	646.2
70.0	3.306	1.377	0.551	1.377					60- 70	3.807	650.0
80.0	0.482	0	0	0					70- 80	0.729	650.7
90.0	0	0	0	0					80- 90	0.033	650.8
100.0	0	0	0	0					90-100	0	650.8
110.0	0	0	0	0					100-110	0	650.8
120.0	0	0	0	0					110-120	0	650.8
130.0	0	0	0	0					120-130	0	650.8
140.0	0	0	0	0					130-140	0	650.8
150.0	0.964	0.344	0.896	0.344					140-150	0.143	650.9
160.0	2.135	1.584	2.066	1.584					150-160	0.573	651.5
170.0	2.411	2.342	2.480	2.342					160-170	0.614	652.1
180.0	2.411	2.342	2.411	2.342					170-180	0.227	652.3
DEG	LUMINOUS INTENSITY:cd								UNIT:lm		

Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:06-29-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:


LUMINANCE LIMITATION CURVES

Report number:

MANUFACTURER:		
Address:		
NAME: FT100 8W 30D	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

LUMINANCE LIMITATION CURVES

GLARE	CLASS	ILLUMINANCE (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

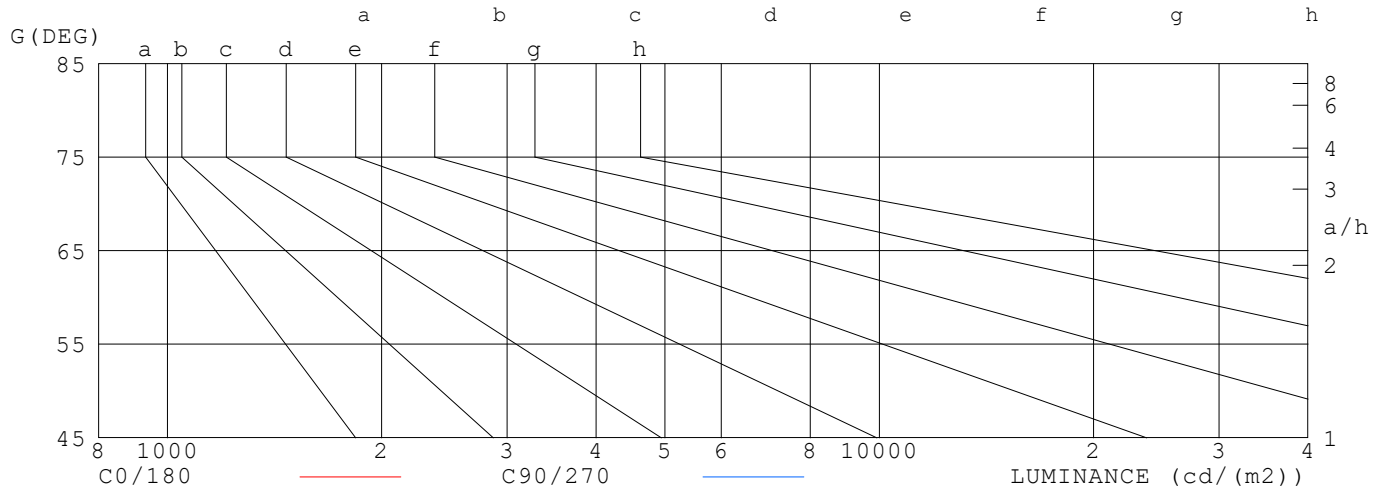

LUMINANCE cd/m2		
G (DEG)	C0/180	C90/270
85	0	0
80	28	0
75	64	0
70	97	40
65	134	86
60	185	145
55	251	239
50	344	372
45	462	572

Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:06-29-2026


Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: FT100 8W 30D	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

UNIT: cd

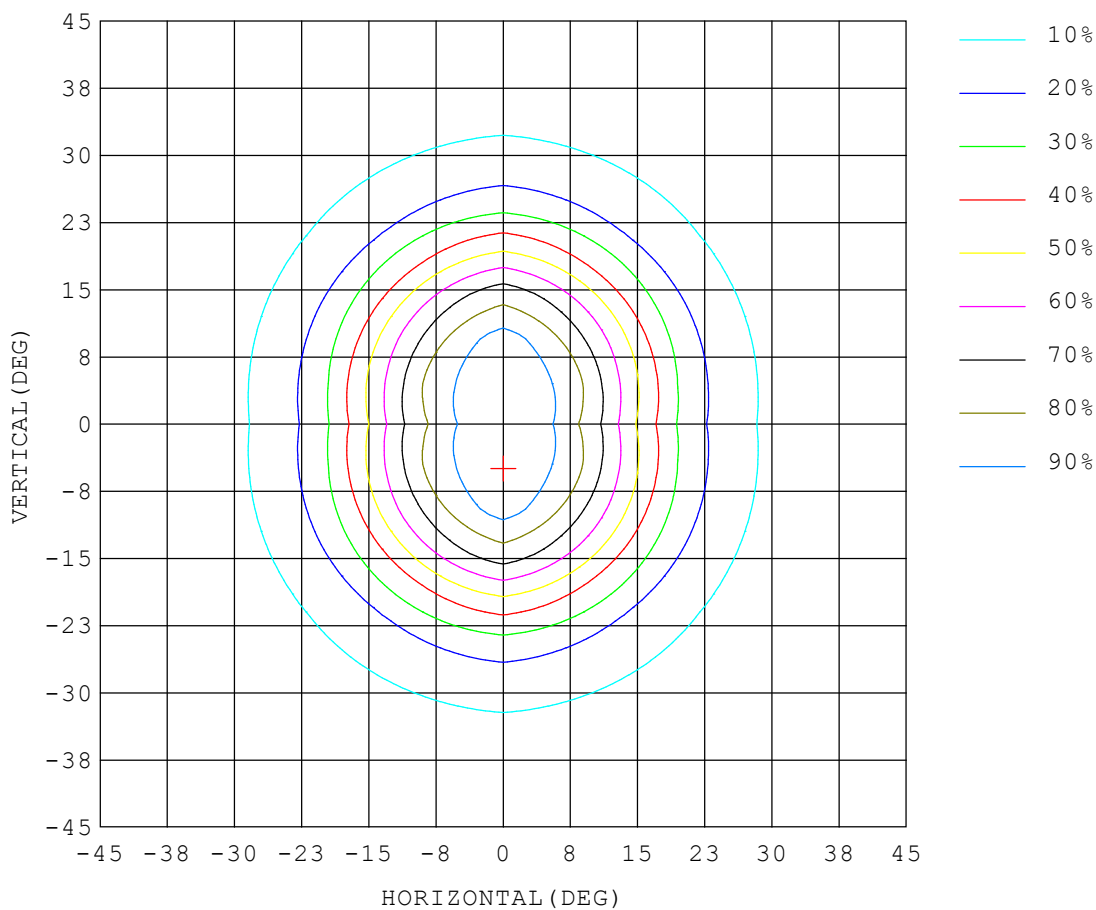


Test System: HopooColor HPG1800
Temperature: 25.3 DEG
Operators:
Test Date: 06-29-2026

Test Set: 5.0 deg/s C-Gamma (TYPE C)
Humidity: 65.0%
Test Distance: 8.300 m
Remarks:

ISOLUX DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: FT100 8W 30D	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

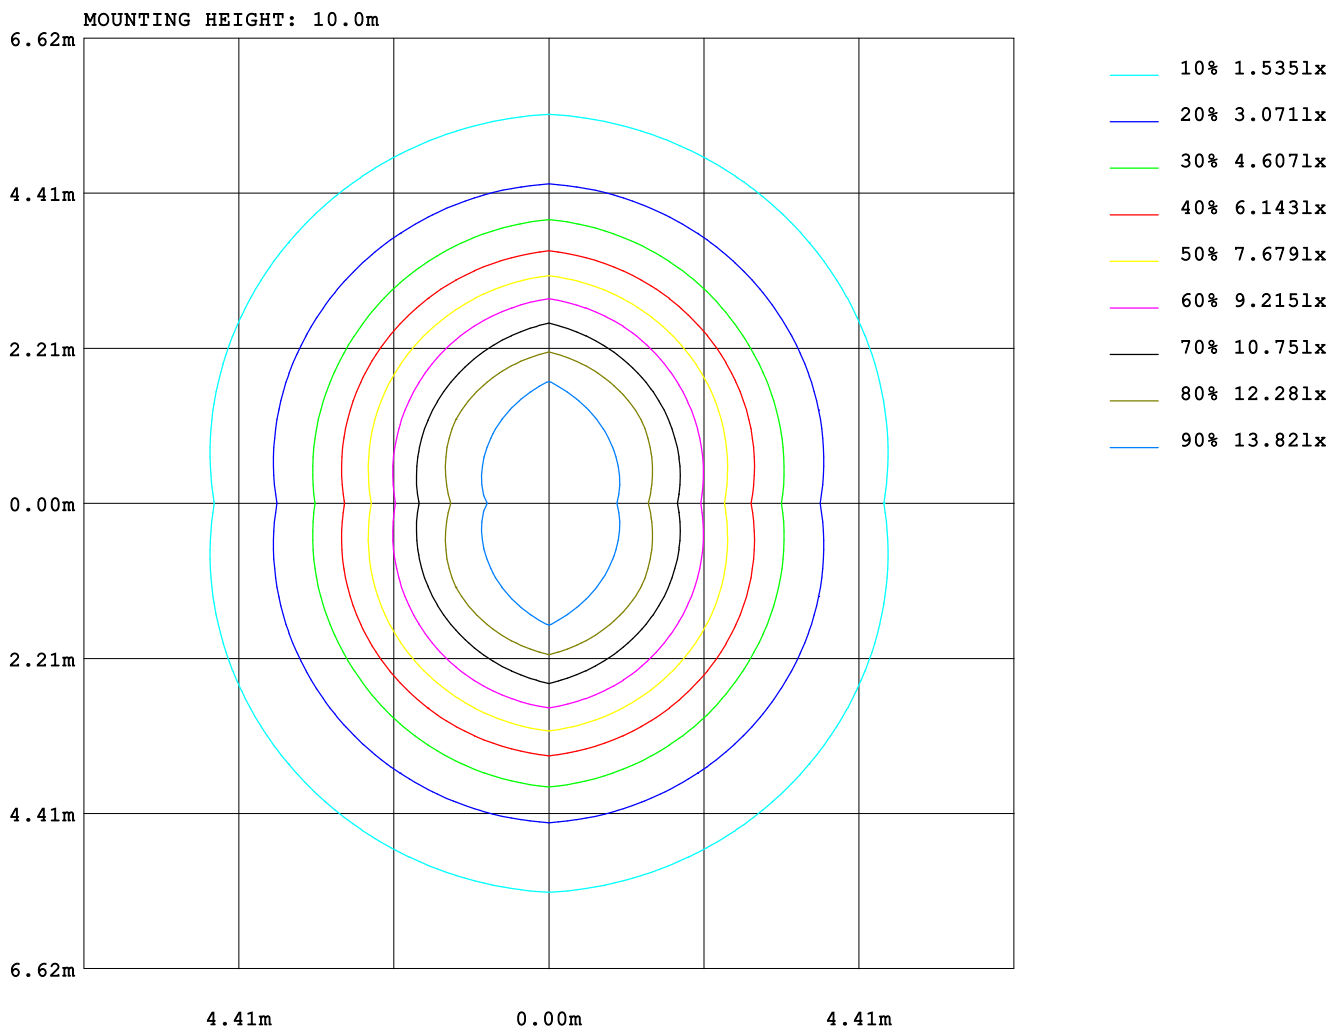

Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:06-29-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:

AREA LUMINOUS FLUX

Report number:

MANUFACTURER:																			
Address:																			
NAME: FT100 8W 30D										TYPE:					WEIGHT:				
SPECIFICATION:										DIMENSION:					SERIAL No.:				

		AREA FLUX DIAGRAM																		UNIT:lm			Φ t	Φ a			
VERTICAL (DEG)	45																										
	40	0.04	0.07	0.11	0.16	0.22	0.27	0.33	0.37	0.40	0.40	0.37	0.33	0.28	0.22	0.17	0.13	0.09	0.07	4.02	0.00						
	35	0.07	0.11	0.17	0.24	0.33	0.42	0.51	0.59	0.65	0.65	0.59	0.51	0.42	0.33	0.25	0.18	0.13	0.09	6.24	0.00						
	30	0.09	0.15	0.24	0.34	0.48	0.64	0.82	0.99	1.11	1.11	0.99	0.82	0.64	0.48	0.35	0.24	0.17	0.11	9.77	1.43						
	25	0.12	0.21	0.32	0.47	0.69	0.98	1.35	1.74	2.04	2.04	1.74	1.35	0.98	0.69	0.47	0.32	0.21	0.14	15.8	10.1						
	20	0.15	0.26	0.41	0.63	0.98	1.54	2.29	3.19	3.90	3.90	3.19	2.29	1.54	0.98	0.63	0.41	0.26	0.17	26.7	22.2						
	15	0.18	0.30	0.50	0.82	1.38	2.35	3.84	5.45	6.70	6.69	5.43	3.83	2.35	1.38	0.82	0.50	0.31	0.19	43.0	39.1						
		0.21	0.35	0.58	1.00	1.81	3.37	5.59	7.82	9.38	9.36	7.79	5.55	3.36	1.81	1.00	0.58	0.35	0.21	60.1	56.6						
		0.22	0.38	0.64	1.13	2.19	4.18	6.90	9.41	10.9	10.9	9.38	6.84	4.15	2.19	1.14	0.64	0.38	0.23	71.9	68.7						
		0.23	0.39	0.66	1.17	2.32	4.47	7.35	9.86	11.2	11.3	9.89	7.27	4.41	2.31	1.17	0.66	0.39	0.23	75.3	72.0						
		0.23	0.39	0.66	1.17	2.32	4.47	7.35	9.86	11.2	11.3	9.89	7.27	4.41	2.31	1.17	0.66	0.39	0.23	75.3	72.0						
		0.22	0.38	0.64	1.13	2.19	4.18	6.90	9.41	10.9	10.9	9.38	6.84	4.15	2.19	1.14	0.64	0.38	0.23	71.9	68.7						
		0.21	0.35	0.58	1.00	1.81	3.37	5.59	7.82	9.38	9.36	7.79	5.55	3.36	1.81	1.00	0.58	0.35	0.21	60.1	56.6						
		0.18	0.30	0.50	0.82	1.38	2.35	3.84	5.45	6.70	6.69	5.43	3.83	2.35	1.38	0.82	0.50	0.31	0.19	43.0	39.1						
		0.15	0.26	0.41	0.63	0.98	1.54	2.29	3.19	3.90	3.90	3.19	2.29	1.54	0.98	0.63	0.41	0.26	0.17	26.7	22.2						
		0.12	0.21	0.32	0.47	0.69	0.98	1.35	1.74	2.04	2.04	1.74	1.35	0.98	0.69	0.47	0.32	0.21	0.14	15.8	10.1						
		0.09	0.15	0.24	0.34	0.48	0.64	0.82	0.99	1.11	1.11	0.99	0.82	0.64	0.48	0.35	0.24	0.17	0.11	9.77	1.43						
		0.07	0.11	0.17	0.24	0.33	0.42	0.51	0.59	0.65	0.65	0.59	0.51	0.42	0.33	0.25	0.18	0.13	0.09	6.24	0.00						
	0.04	0.07	0.11	0.16	0.22	0.27	0.33	0.37	0.40	0.40	0.37	0.33	0.28	0.22	0.17	0.13	0.09	0.07	4.02	0.00							
		-45	-40	-35	-30	-25	-20	-15	-10	HORIZONTAL (DEG)										10	15	20	25	30	35	40	45
Φ t		2.62	4.42	7.23	11.9	20.8	36.4	57.9	78.9	92.7	92.9	78.8	57.6	36.2	20.8	12.0	7.31	4.57	2.87	652							
Φ a		0.00	0.00	0.00	3.99	15.5	32.1	54.1	75.3	89.4	89.7	75.3	53.7	31.9	15.5	3.99	0.00	0.00	0.00		543						

 Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:06-29-2026


 Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Report number:

MANUFACTURER:															
Address:															
NAME: FT100 8W 30D								TYPE:				WEIGHT:			
SPECIFICATION:								DIMENSION:				SERIAL No.:			

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.00
1.0	1.12	1.09	1.07	1.09	1.07	1.06	1.05	1.04	1.02	1.02	1.00	.99	.98	.97	.96	.95
2.0	1.05	1.01	.98	1.03	1.00	.97	1.00	.97	.95	.97	.95	.93	.94	.93	.91	.90
3.0	.99	.95	.91	.98	.94	.90	.95	.92	.89	.93	.90	.88	.90	.88	.86	.85
4.0	.94	.89	.85	.93	.88	.85	.91	.87	.84	.89	.85	.83	.87	.84	.82	.80
5.0	.89	.84	.80	.88	.83	.80	.86	.82	.79	.85	.81	.78	.83	.80	.78	.76
6.0	.85	.80	.76	.84	.79	.76	.83	.78	.75	.81	.77	.75	.80	.77	.74	.73
7.0	.81	.76	.72	.80	.75	.72	.79	.75	.72	.78	.74	.71	.77	.73	.71	.70
8.0	.77	.72	.69	.77	.72	.69	.76	.71	.68	.75	.71	.68	.74	.70	.68	.67
9.0	.74	.69	.66	.74	.69	.66	.73	.68	.65	.72	.68	.65	.71	.68	.65	.64
10.0	.71	.66	.63	.71	.66	.63	.70	.66	.63	.69	.65	.63	.69	.65	.62	.61

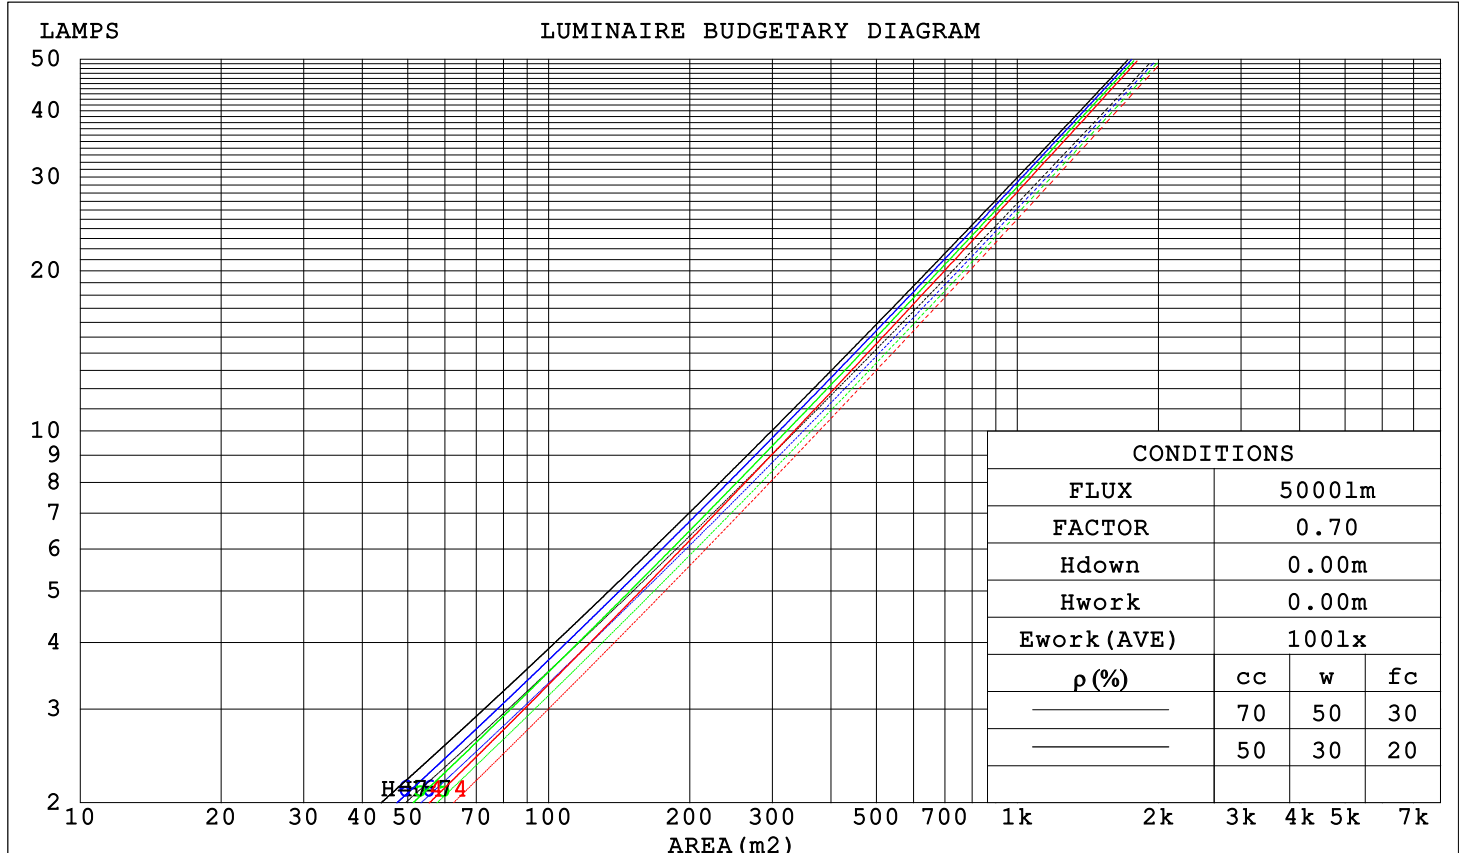
 Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:06-29-2026

 Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

WEC AND CCEC

Report number:

MANUFACTURER:															
Address:															
NAME: FT100 8W 30D								TYPE:				WEIGHT:			
SPECIFICATION:								DIMENSION:				SERIAL No.:			

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients (WEC)									
0.0																
1.0	.160	.091	.029	.154	.088	.028	.141	.081	.026	.129	.075	.024	.119	.069	.022	
2.0	.152	.083	.026	.146	.081	.025	.136	.075	.023	.126	.071	.022	.117	.066	.021	
3.0	.143	.076	.023	.139	.074	.022	.130	.070	.021	.122	.067	.020	.114	.063	.020	
4.0	.136	.071	.021	.132	.069	.020	.124	.066	.020	.117	.063	.019	.110	.060	.018	
5.0	.129	.066	.019	.125	.064	.019	.119	.062	.018	.112	.059	.018	.107	.057	.017	
6.0	.122	.061	.018	.119	.060	.017	.113	.058	.017	.108	.056	.017	.103	.054	.016	
7.0	.116	.058	.016	.114	.057	.016	.109	.055	.016	.104	.053	.016	.099	.052	.015	
8.0	.111	.054	.015	.109	.054	.015	.104	.052	.015	.100	.051	.015	.096	.049	.014	
9.0	.106	.051	.014	.104	.051	.014	.100	.050	.014	.096	.048	.014	.093	.047	.014	
10.0	.102	.049	.014	.100	.048	.013	.096	.047	.013	.093	.046	.013	.090	.045	.013	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.192	.192	.192	.164	.164	.164	.112	.112	.112	.064	.064	.064	.021	.021	.021	
1.0	.172	.159	.148	.147	.137	.127	.101	.094	.088	.058	.054	.051	.019	.018	.017	
2.0	.155	.134	.117	.133	.116	.101	.091	.080	.070	.053	.047	.041	.017	.015	.013	
3.0	.142	.115	.094	.122	.099	.082	.084	.069	.057	.048	.040	.034	.016	.013	.011	
4.0	.131	.100	.077	.112	.087	.067	.077	.060	.047	.045	.035	.028	.014	.012	.009	
5.0	.121	.088	.064	.104	.076	.056	.072	.053	.039	.042	.031	.023	.013	.010	.008	
6.0	.113	.079	.054	.097	.068	.047	.067	.048	.033	.039	.028	.020	.013	.009	.007	
7.0	.106	.071	.046	.091	.062	.040	.063	.043	.029	.037	.025	.017	.012	.008	.006	
8.0	.100	.065	.040	.086	.056	.035	.060	.039	.025	.035	.023	.015	.011	.008	.005	
9.0	.095	.059	.035	.082	.051	.031	.057	.036	.022	.033	.021	.013	.011	.007	.004	
10.0	.090	.055	.031	.078	.047	.027	.054	.033	.019	.031	.020	.011	.010	.006	.004	

Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:06-29-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

Uncorrected UGR Table

Report number:

MANUFACTURER:											
Address:											
NAME: FT100 8W 30D					TYPE:			WEIGHT:			
SPECIFICATION:					DIMENSION:			SERIAL No.:			
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3	
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3	
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
Room dimensions		Viewed crosswise				Viewed endwise					
x = 2H y = 2H	2H	2.7	3.5	2.9	3.7	3.8	3.4	4.2	3.6	4.3	4.5
	3H	2.8	3.5	3.0	3.7	3.9	3.3	4.0	3.5	4.2	4.4
	4H	2.7	3.5	3.0	3.7	3.9	3.2	3.9	3.5	4.1	4.3
	6H	2.7	3.3	3.0	3.6	3.8	3.1	3.8	3.4	4.0	4.3
	8H	2.6	3.3	2.9	3.5	3.8	3.0	3.7	3.4	3.9	4.2
	12H	2.6	3.2	2.9	3.5	3.7	3.0	3.6	3.3	3.9	4.2
4H	2H	2.6	3.4	2.9	3.6	3.8	3.3	4.0	3.5	4.2	4.4
	3H	2.7	3.4	3.1	3.6	3.9	3.2	3.8	3.5	4.1	4.3
	4H	2.7	3.3	3.1	3.6	3.9	3.1	3.6	3.4	3.9	4.3
	6H	2.6	3.1	3.0	3.5	3.8	3.0	3.5	3.4	3.8	4.2
	8H	2.6	3.0	3.0	3.4	3.8	2.9	3.4	3.3	3.7	4.1
	12H	2.5	2.9	2.9	3.3	3.7	2.9	3.3	3.3	3.7	4.1
8H	4H	2.6	3.0	3.0	3.4	3.8	2.9	3.4	3.3	3.8	4.1
	6H	2.5	2.9	2.9	3.3	3.7	2.8	3.2	3.3	3.6	4.0
	8H	2.4	2.8	2.9	3.2	3.6	2.8	3.1	3.2	3.5	4.0
	12H	2.4	2.7	2.8	3.1	3.6	2.7	3.0	3.2	3.5	3.9
12H	4H	2.5	2.9	2.9	3.3	3.7	2.9	3.3	3.3	3.7	4.1
	6H	2.4	2.8	2.9	3.2	3.6	2.8	3.1	3.2	3.5	4.0
	8H	2.4	2.7	2.8	3.1	3.6	2.7	3.0	3.2	3.5	3.9
Variations with the observer position at spacings:											
S = 1.0H	+ 1.7 / - 2.9					+ 2.3 / - 4.9					
1.5H	+ 2.2 / - 2.6					+ 3.2 / - 3.8					
2.0H	+ 3.2 / - 3.3					+ 4.7 / - 4.3					

CIE Pub.117 Corrected 652.3 lm Total Lamp Luminous Flux.(8log(F/F0) = -1.5)

Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:06-29-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:

Report number:

MANUFACTURER:		
Address:		
NAME: FT100 8W 30D	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No. :


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	87	81	77	86	80	77	86	80	77	73
0.80	94	89	85	94	88	85	93	88	84	81
1.00	99	93	90	98	93	89	97	93	89	85
1.25	103	98	94	102	97	94	100	96	93	89
1.50	106	101	98	105	100	97	102	99	96	92
2.00	108	104	101	107	103	100	104	101	99	94
2.50	110	106	103	109	105	102	105	103	101	95
3.00	112	108	106	110	107	105	107	104	102	96
4.00	114	111	109	112	109	107	108	106	105	97
5.00	115	113	111	113	111	109	109	107	106	98
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: FT100 8W 30D	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

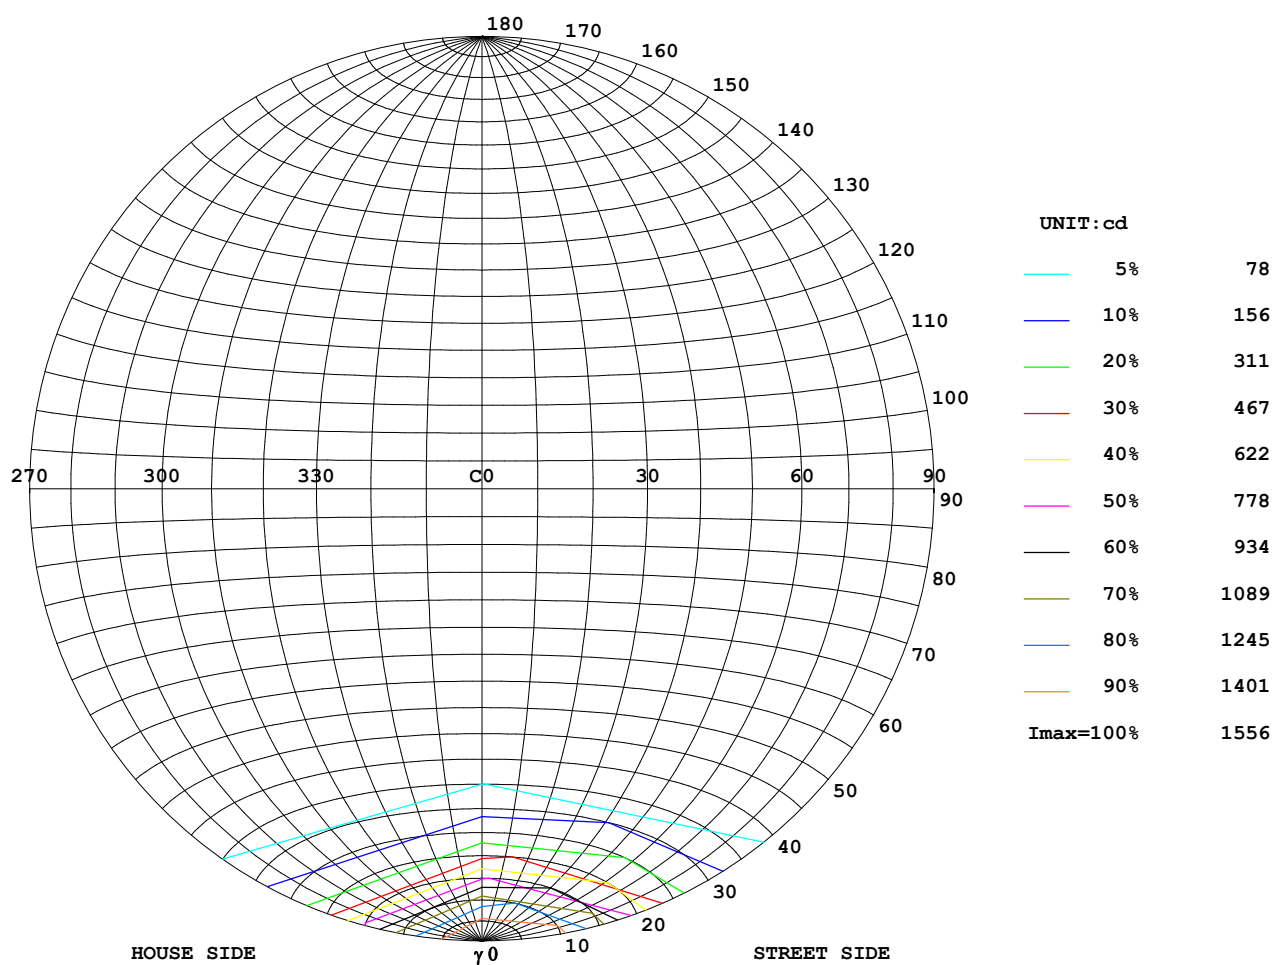

Test System: HopooColor HPG1800
 Temperature: 25.3 DEG
 Operators:
 Test Date: 06-29-2026


Test Set: 5.0 deg/s C-Gamma (TYPE C)
 Humidity: 65.0%
 Test Distance: 8.300 m
 Remarks:

ISOLUX DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: FT100 8W 30D	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

ILLUMINANCE AT MH=10 m, Enadir = 15.26 lx

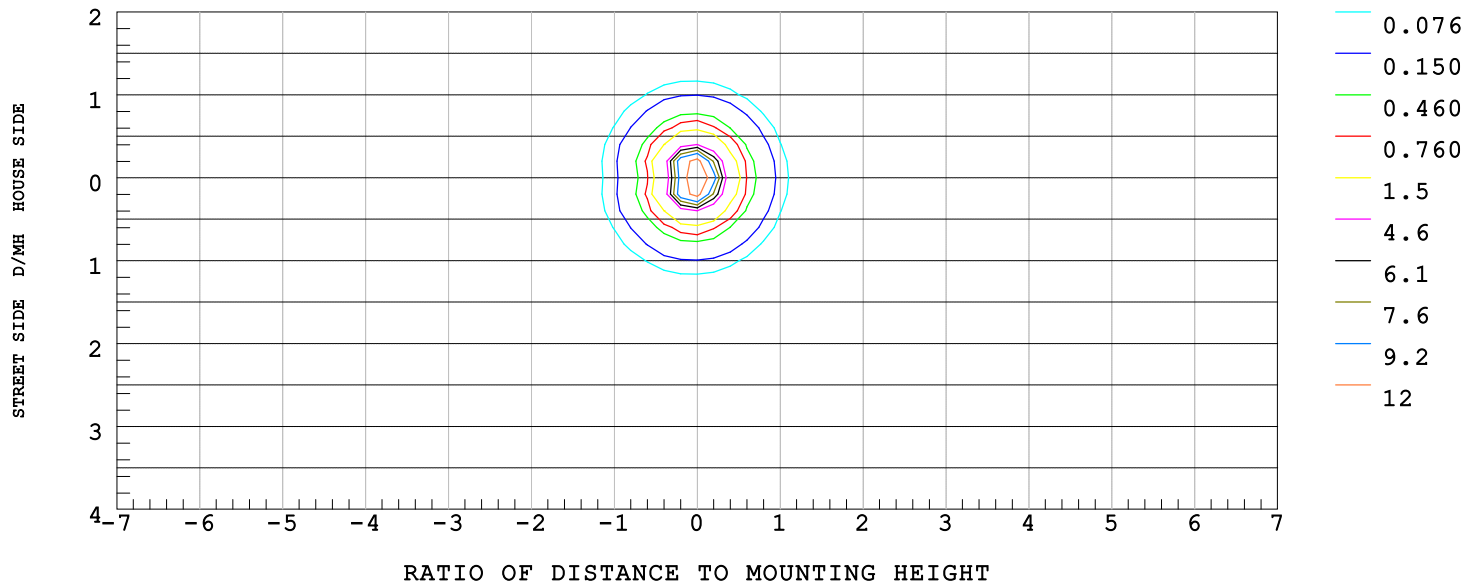

 Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:06-29-2026

 Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: FT100 8W 30D	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

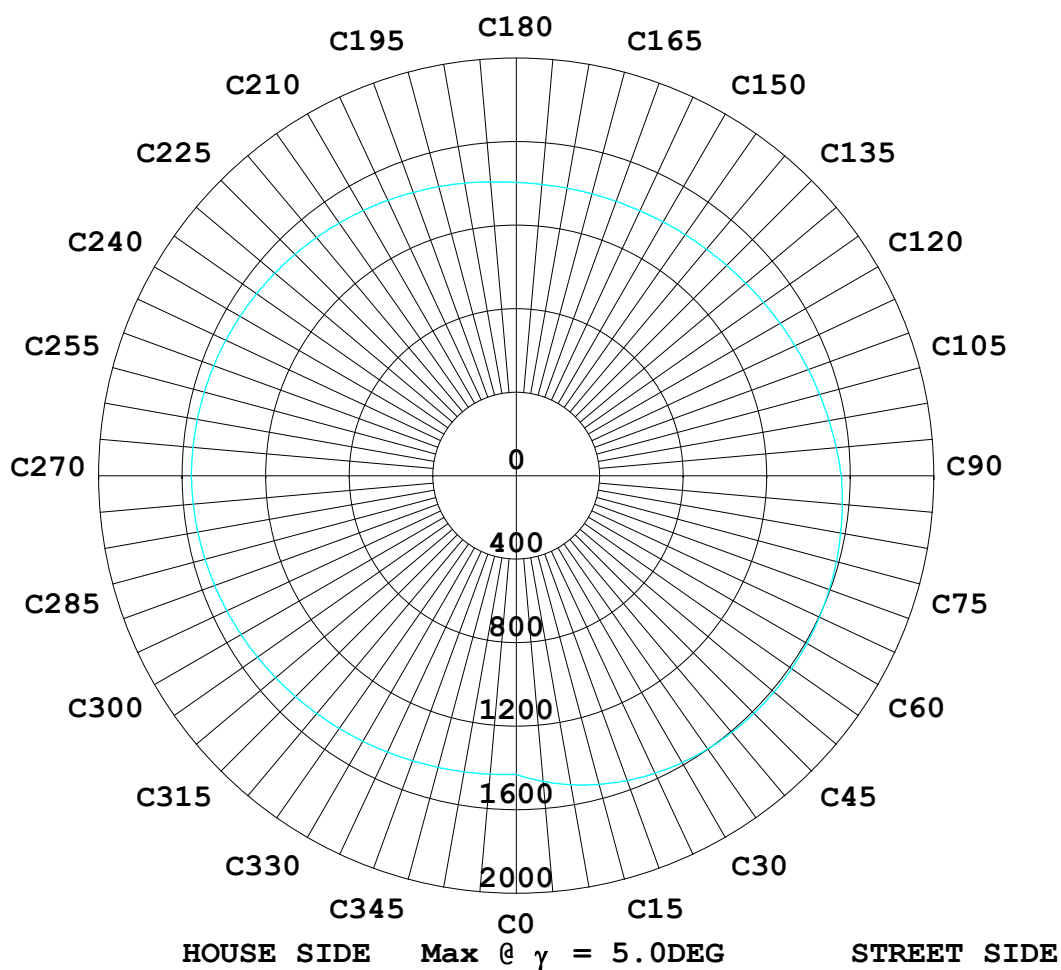

Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:06-29-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Report number:

MANUFACTURER:		
Address:		
NAME: FT100 8W 30D	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

UNIT: cd

C (DEG)				
γ (DEG)	0	90	180	270
0.0	1526	1493	1479	1493
5.0	1431	1556	1405	1556
10.0	1160	1442	1168	1442
15.0	763	1145	779	1145
20.0	424	715	427	715
25.0	218	368	217	368
30.0	124	193	124	193
35.0	77.5	109	77.7	109
40.0	49.7	65.8	49.1	65.8
45.0	32.6	40.4	31.3	40.4
50.0	22.1	23.9	16.3	23.9
55.0	14.3	13.7	7.71	13.7
60.0	9.23	7.23	3.37	7.23
65.0	5.64	3.65	1.10	3.65
70.0	3.30	1.37	0.55	1.37
75.0	1.65	0.00	0.34	0.00
80.0	0.48	0.00	0.00	0.00
85.0	0.00	0.00	0.00	0.00
90.0	0.00	0.00	0.00	0.00
95.0	0.00	0.00	0.00	0.00
100.0	0.00	0.00	0.00	0.00
105.0	0.00	0.00	0.00	0.00
110.0	0.00	0.00	0.00	0.00
115.0	0.00	0.00	0.00	0.00
120.0	0.00	0.00	0.00	0.00
125.0	0.00	0.00	0.00	0.00
130.0	0.00	0.00	0.00	0.00
135.0	0.00	0.00	0.00	0.00
140.0	0.00	0.00	0.00	0.00
145.0	0.34	0.00	0.28	0.00
150.0	0.96	0.34	0.90	0.34
155.0	1.58	1.03	1.51	1.03
160.0	2.13	1.58	2.06	1.58
165.0	2.41	2.13	2.34	2.13
170.0	2.41	2.34	2.48	2.34
175.0	2.41	2.34	2.41	2.34
180.0	2.41	2.34	2.41	2.34

Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:06-29-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks: