


LUMINAIRE PHOTOMETRIC TEST REPORT

Report number:


MANUFACTURER:		
Address:		
NAME:	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

DATA OF LAMP		Imax(cd)	3072	S/MH (C0/180)	0.69
MODEL		EFFICIENCY (%)	100.0	S/MH (C90/270)	0.71
NOMINAL POWER(W)	34	TOTAL FLUX(lm)	2493.7	Voltage(V)	220.3
RATED VOLTAGE (V)	220	EFFICIENCY (lm/W)	75.3	Current(A)	0.162
NOMINAL FLUX(lm)	2493.7	η up (%)	0.6	Power(W)	33.13
LAMPS QUANTITY	1	η down (%)	99.4	Power Factor (PF)	0.931
TEST VOLTAGE (V)	220.4	Effective Flux(lm)	2387.9	EEI	0.000 (E)

LUMINOUS INTENSITY DISTRIBUTION

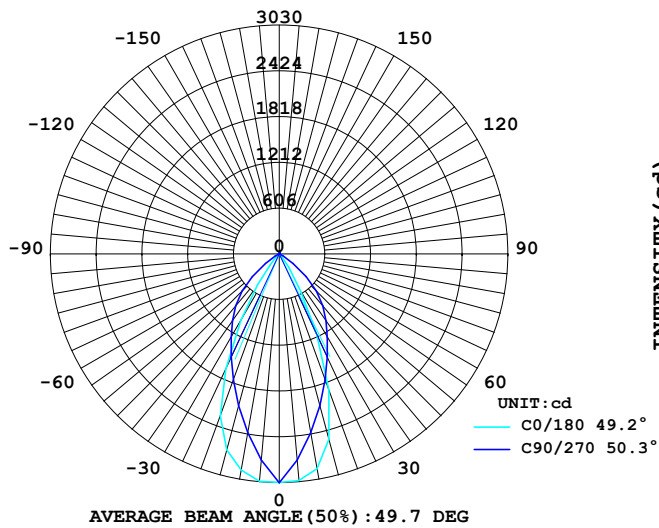

LUMINOUS INTENSITY DISTRIBUTION

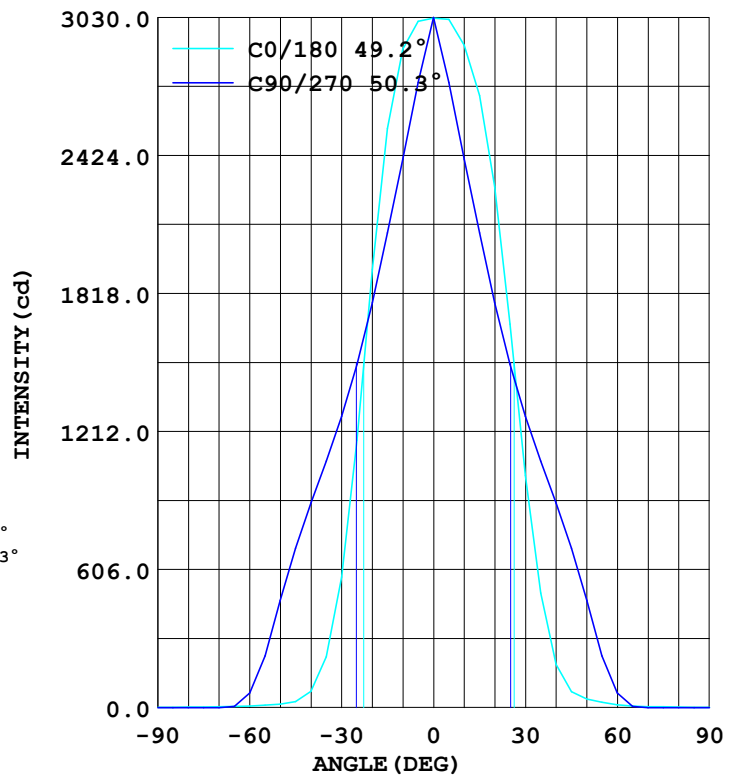


Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:2026年07月27日

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:

AVERAGE AND CENTER E Figure

Report number:

MANUFACTURER:		
Address:		
NAME:	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

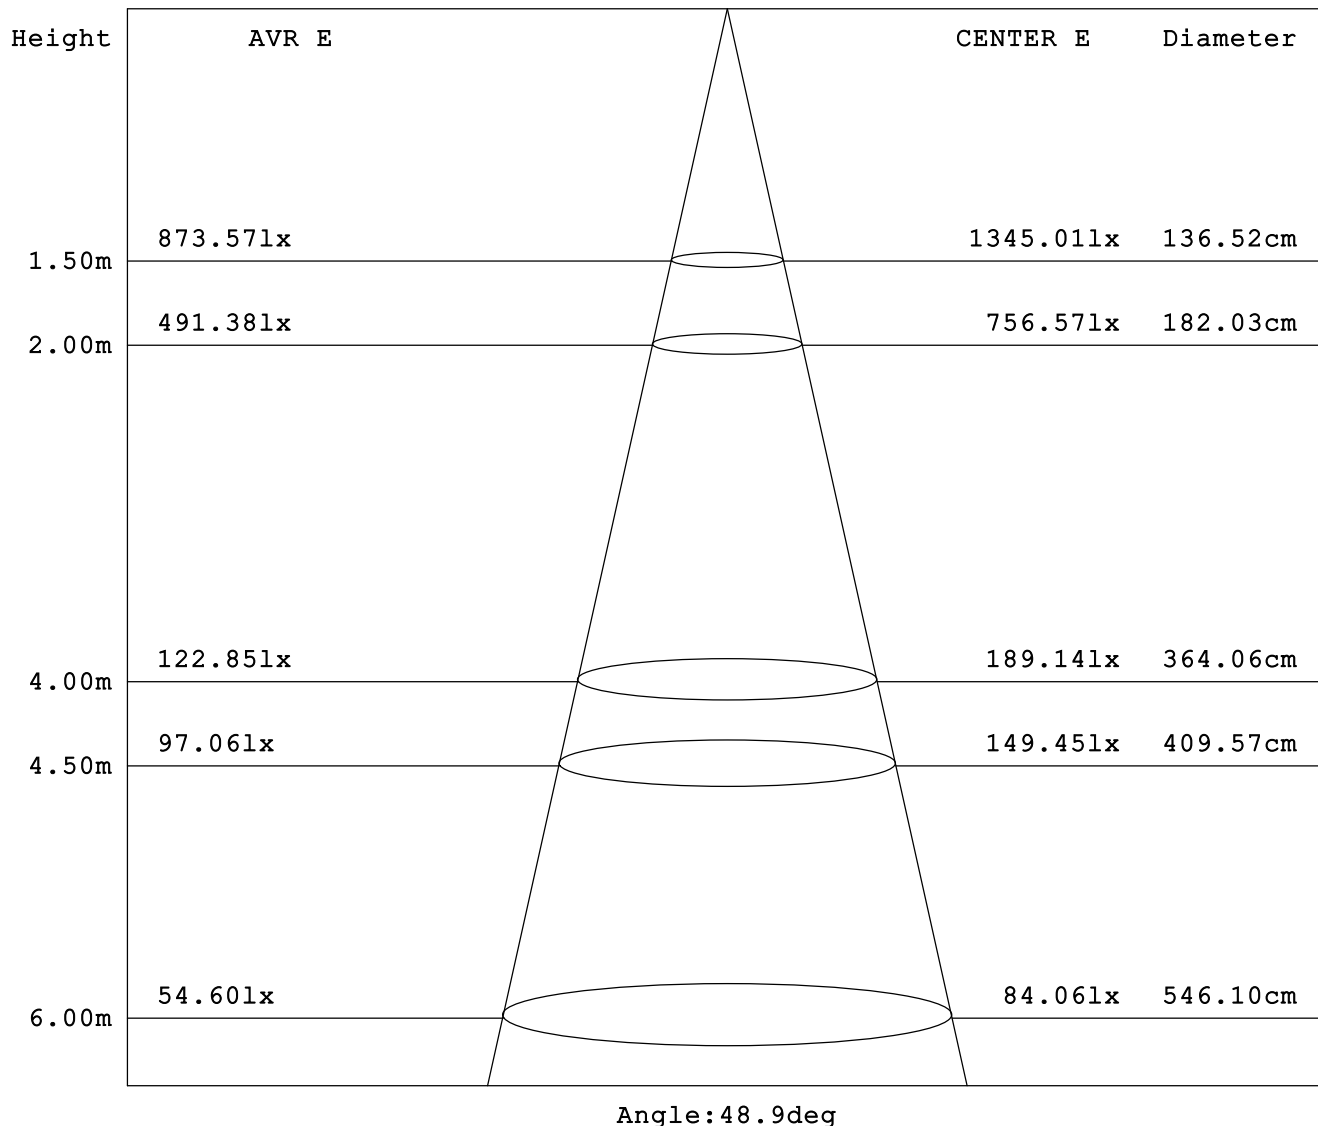

Test System: HopooColor HPG1800
 Temperature: 25.3DEG
 Operators:
 Test Date: 2026年07月27日

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity: 65.0%
 Test Distance: 8.300 m
 Remarks:

ZONAL FLUX DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME:	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

γ	C0	C90	C180	C270					γ	Zone	total
10.0	2891	2407	2907	2407					0- 10	268.7	268.7
20.0	1923	1777	2287	1777					10- 20	650.2	918.9
30.0	572.6	1278	1019	1278					20- 30	674.4	1593
40.0	71.02	897.5	188.8	897.5					30- 40	465.1	2059
50.0	15.29	469.6	37.26	469.6					40- 50	289.7	2348
60.0	6.889	64.41	12.53	64.41					50- 60	117.2	2466
70.0	3.444	0	4.133	0					60- 70	12.14	2478
80.0	1.722	0	1.928	0					70- 80	1.459	2479
90.0	0.758	0	0.758	0					80- 90	0.699	2480
100.0	0.344	0	0.413	0					90-100	0.296	2480
110.0	0.344	0	0.276	0					100-110	0.182	2480
120.0	1.033	0	0.413	0					110-120	0.230	2481
130.0	2.755	0	1.791	0					120-130	0.640	2481
140.0	5.235	2.342	4.202	2.342					130-140	1.737	2483
150.0	7.715	5.717	7.095	5.717					140-150	3.129	2486
160.0	9.989	8.749	9.644	8.749					150-160	3.665	2490
170.0	11.71	10.47	11.71	10.47					160-170	2.870	2493
180.0	11.98	12.40	12.60	12.40					170-180	1.113	2494
DEG	LUMINOUS INTENSITY:cd								UNIT:lm		

Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:2026年07月27日

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:


LUMINANCE LIMITATION CURVES

Report number:

MANUFACTURER:		
Address:		
NAME:	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

LUMINANCE LIMITATION CURVES

GLARE	CLASS	ILLUMINANCE (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

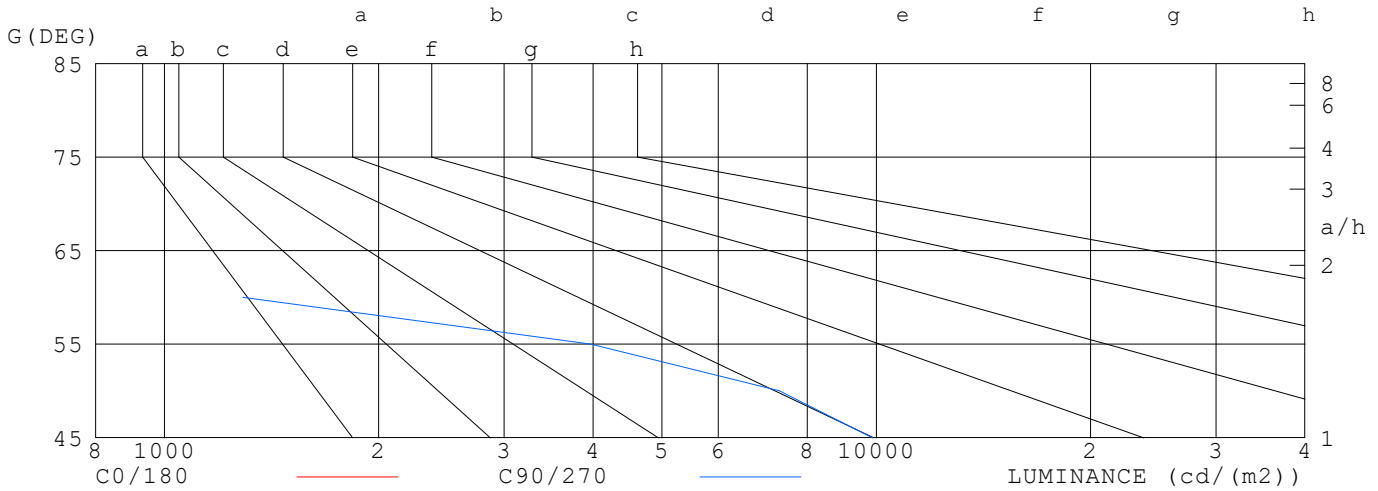

LUMINANCE cd/m2

G (DEG)	C0/180	C90/270
85	142	0
80	99	0
75	98	0
70	101	0
65	111	119
60	138	1288
55	183	3968
50	238	7307
45	374	9880

Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:2026年07月27日


Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME:	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

UNIT: cd

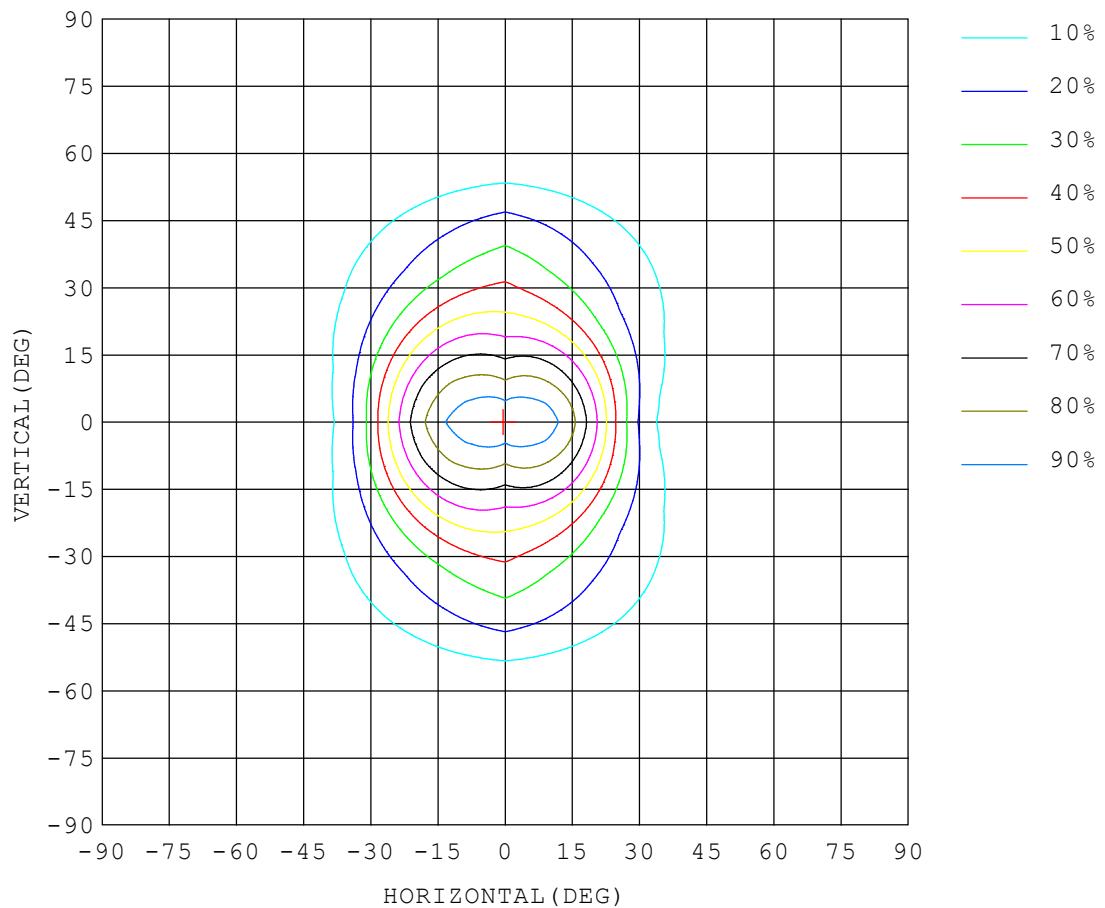


Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:2026年07月27日

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:

ISOLUX DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME:	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

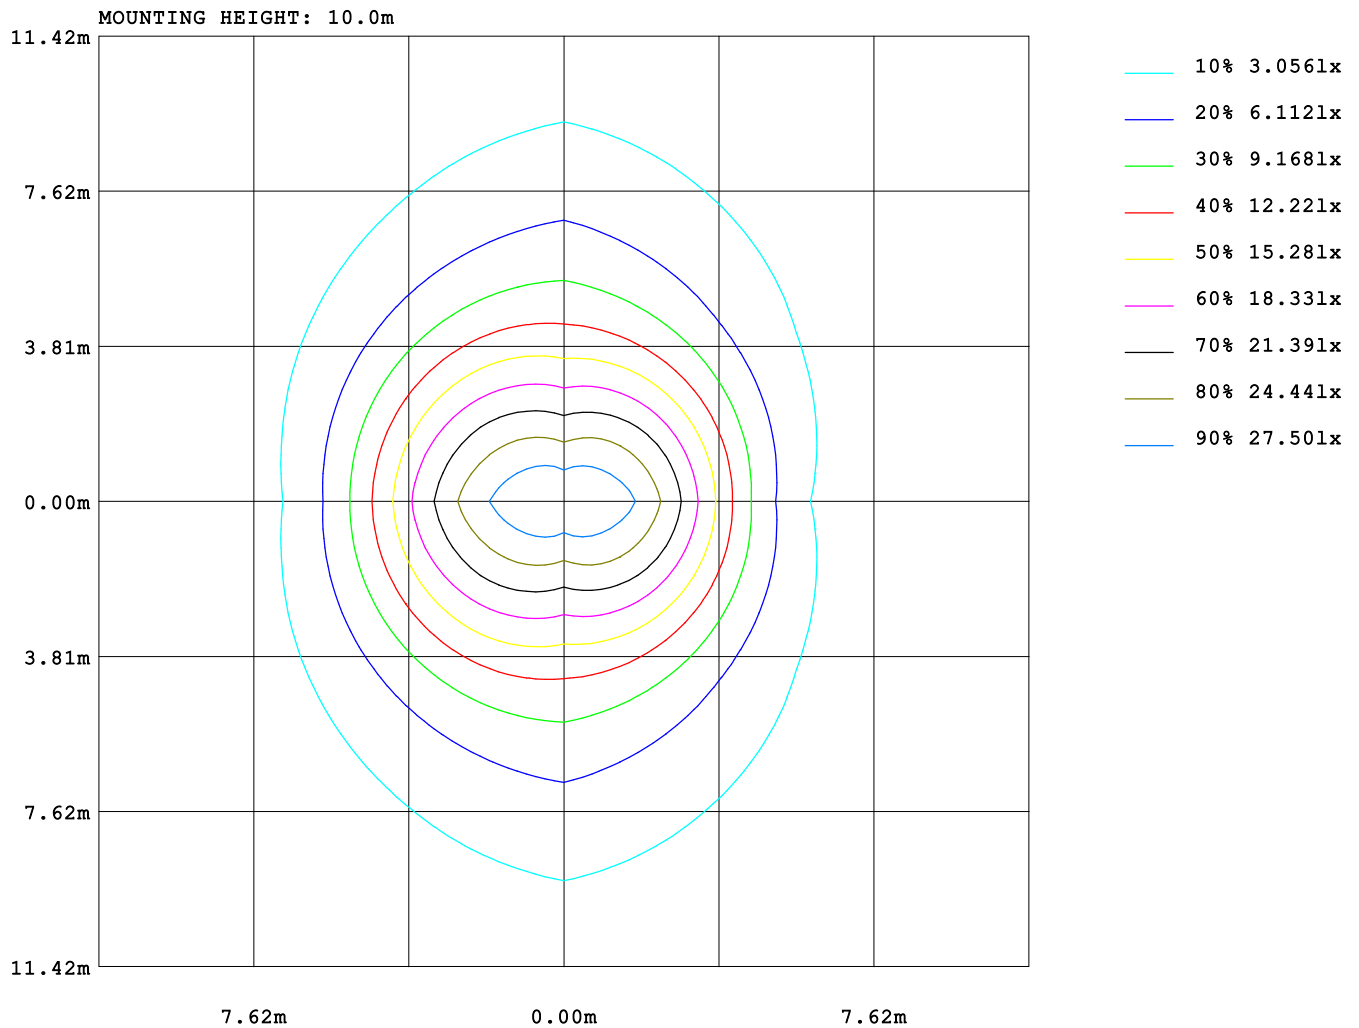

Test System: HopooColor HPG1800
 Temperature: 25.3DEG
 Operators:
 Test Date: 2026年07月27日

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity: 65.0%
 Test Distance: 8.300 m
 Remarks:

AREA LUMINOUS FLUX

Report number:

MANUFACTURER:																			
Address:																			
NAME:										TYPE:					WEIGHT:				
SPECIFICATION:										DIMENSION:					SERIAL No.:				

VERTICAL (DEG)	AREA FLUX DIAGRAM																		UNIT:lm		Φ t	Φ a
	90	80	70	60	50	40	30	20	10	0	10	20	30	40	50	60	70	80	90			
90 80 70 60 50 40 30 -30 -40 -50 -60 -70 -80 -90	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.14	0.00		
	0.00	0.01	0.01	0.02	0.02	0.02	0.02	0.01	0.01	0.00	0.01	0.02	0.02	0.02	0.02	0.01	0.01	0.00	0.25	0.00		
	0.00	0.01	0.02	0.03	0.04	0.06	0.15	0.34	0.52	0.51	0.33	0.14	0.05	0.04	0.03	0.02	0.01	0.00	2.28	0.00		
	0.00	0.01	0.03	0.05	0.17	0.78	2.35	4.65	6.80	6.77	4.58	2.28	0.73	0.14	0.04	0.02	0.01	0.00	29.4	6.92		
	0.00	0.01	0.04	0.13	0.90	3.57	8.37	14.1	19.1	19.0	13.8	8.12	3.41	0.82	0.11	0.03	0.01	0.00	91.7	74.9		
	0.00	0.02	0.05	0.36	2.25	6.96	14.5	23.6	30.7	30.0	22.0	13.3	6.49	2.05	0.30	0.04	0.02	0.00	153	140		
	0.00	0.02	0.07	0.64	3.22	9.57	22.3	37.3	45.4	43.6	32.6	18.1	8.03	2.83	0.53	0.06	0.02	0.00	225	213		
	0.00	0.02	0.10	0.74	3.32	12.3	33.7	56.2	64.7	63.4	50.4	25.5	8.56	2.60	0.57	0.07	0.02	0.00	323	311		
	0.00	0.02	0.10	0.57	2.62	14.2	43.7	72.4	83.5	83.2	67.6	32.4	7.98	1.51	0.35	0.07	0.02	0.00	411	402		
	0.00	0.02	0.10	0.57	2.62	14.2	43.7	72.4	83.5	83.2	67.6	32.4	7.98	1.51	0.35	0.07	0.02	0.00	411	402		
	0.00	0.02	0.10	0.74	3.32	12.3	33.7	56.2	64.7	63.4	50.4	25.5	8.56	2.60	0.57	0.07	0.02	0.00	323	311		
	0.00	0.02	0.07	0.64	3.22	9.57	22.3	37.3	45.4	43.6	32.6	18.1	8.03	2.83	0.53	0.06	0.02	0.00	225	213		
	0.00	0.02	0.05	0.36	2.25	6.96	14.5	23.6	30.7	30.0	22.0	13.3	6.49	2.05	0.30	0.04	0.02	0.00	153	140		
	0.00	0.01	0.04	0.13	0.90	3.57	8.37	14.1	19.1	19.0	13.8	8.12	3.41	0.82	0.11	0.03	0.01	0.00	91.7	74.9		
	0.00	0.01	0.03	0.05	0.17	0.78	2.35	4.65	6.80	6.77	4.58	2.28	0.73	0.14	0.04	0.02	0.01	0.00	29.4	6.92		
	0.00	0.01	0.02	0.03	0.04	0.06	0.15	0.34	0.52	0.51	0.33	0.14	0.05	0.04	0.03	0.02	0.01	0.00	2.28	0.00		
	0.00	0.01	0.01	0.02	0.02	0.02	0.02	0.01	0.01	0.00	0.01	0.02	0.02	0.02	0.02	0.01	0.01	0.00	0.25	0.00		
	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.14	0.00		
HORIZONTAL (DEG)																						
Φ t	0.06	0.27	0.87	5.10	25.1	95.1	250	418	502	493	383	200	70.6	20.1	3.90	0.67	0.24	0.05	2494			
Φ a	0.00	0.00	0.00	0.00	0.00	70.8	239	408	494	485	374	188	37.0	0.00	0.00	0.00	0.00	0.00		2388		

 Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:2026年07月27日


 Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME:	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

pcc	80%			70%			50%			30%			10%			0														
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0														
pfc	20%			20%			20%			20%			20%			0														
RCR	RCR:Room Cavity Ratio															Coefficients of Utilization(CU)														
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	.99														
1.0	1.10	1.08	1.05	1.08	1.06	1.03	1.04	1.02	1.00	.90	.98	.97	.96	.95	.94	.92														
2.0	1.02	.98	.94	1.00	.96	.93	.97	.93	.91	.94	.91	.89	.91	.89	.87	.85														
3.0	.94	.89	.85	.93	.88	.84	.90	.86	.83	.88	.84	.81	.85	.82	.80	.78														
4.0	.88	.82	.77	.86	.81	.77	.84	.79	.76	.82	.78	.75	.80	.77	.74	.72														
5.0	.82	.75	.71	.81	.75	.70	.79	.74	.70	.77	.73	.69	.75	.71	.68	.67														
6.0	.76	.70	.65	.75	.69	.65	.74	.68	.65	.72	.68	.64	.71	.67	.64	.62														
7.0	.71	.65	.61	.71	.65	.60	.69	.64	.60	.68	.63	.60	.67	.62	.59	.58														
8.0	.67	.61	.56	.66	.60	.56	.65	.60	.56	.64	.59	.56	.63	.59	.55	.54														
9.0	.63	.57	.53	.63	.57	.53	.62	.56	.52	.61	.56	.52	.60	.55	.52	.51														
10.0	.60	.53	.49	.59	.53	.49	.58	.53	.49	.57	.52	.49	.57	.52	.49	.48														

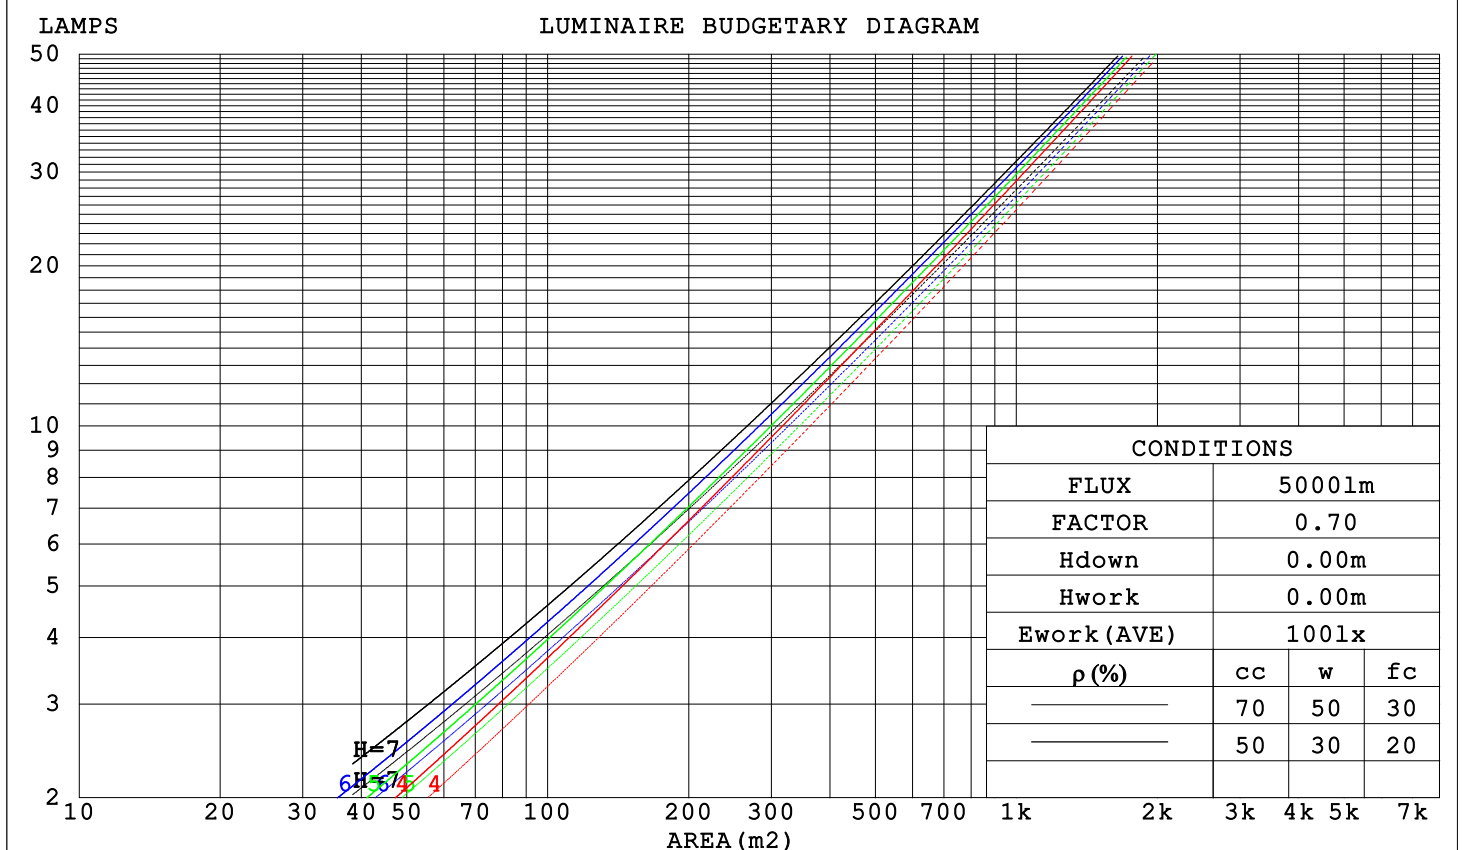

Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:2026年07月27日

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:

WEC AND CCEC

Report number:

MANUFACTURER:															
Address:															
NAME:								TYPE:				WEIGHT:			
SPECIFICATION:								DIMENSION:				SERIAL No.:			

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pf _c	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients (WEC)									
0.0																
1.0	.187	.107	.034	.181	.103	.033	.168	.096	.031	.156	.090	.029	.145	.084	.027	
2.0	.181	.099	.030	.175	.097	.030	.164	.091	.028	.154	.087	.027	.145	.082	.026	
3.0	.173	.092	.028	.168	.090	.027	.159	.086	.026	.150	.082	.025	.142	.079	.024	
4.0	.165	.086	.025	.161	.084	.025	.153	.081	.024	.145	.078	.023	.138	.075	.023	
5.0	.157	.080	.023	.154	.079	.023	.146	.076	.022	.140	.074	.022	.133	.071	.021	
6.0	.150	.075	.022	.147	.074	.021	.140	.072	.021	.134	.070	.020	.129	.068	.020	
7.0	.143	.071	.020	.140	.070	.020	.134	.068	.020	.129	.066	.019	.124	.064	.019	
8.0	.136	.067	.019	.134	.066	.019	.129	.064	.018	.124	.063	.018	.119	.061	.018	
9.0	.130	.063	.018	.128	.062	.017	.123	.061	.017	.119	.060	.017	.115	.058	.017	
10.0	.124	.060	.017	.122	.059	.016	.118	.058	.016	.114	.057	.016	.111	.056	.016	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pf _c	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.195	.195	.195	.166	.166	.166	.114	.114	.114	.065	.065	.065	.021	.021	.021	
1.0	.176	.161	.148	.151	.139	.128	.103	.095	.088	.059	.055	.051	.019	.018	.017	
2.0	.162	.137	.116	.139	.118	.100	.095	.081	.070	.055	.047	.041	.018	.015	.013	
3.0	.150	.118	.092	.129	.102	.080	.088	.071	.056	.051	.041	.033	.016	.013	.011	
4.0	.141	.103	.075	.121	.089	.065	.083	.062	.046	.048	.036	.027	.015	.012	.009	
5.0	.132	.092	.062	.114	.080	.054	.078	.056	.038	.045	.033	.023	.015	.011	.007	
6.0	.125	.083	.053	.107	.072	.046	.074	.050	.032	.043	.030	.019	.014	.010	.006	
7.0	.119	.075	.045	.102	.065	.039	.071	.046	.028	.041	.027	.017	.013	.009	.005	
8.0	.113	.069	.039	.097	.060	.034	.067	.042	.024	.039	.025	.015	.013	.008	.005	
9.0	.108	.064	.035	.093	.056	.030	.064	.039	.022	.037	.023	.013	.012	.008	.004	
10.0	.103	.060	.031	.089	.052	.027	.062	.037	.019	.036	.022	.011	.012	.007	.004	

Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:2026年07月27日

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

Uncorrected UGR Table

Report number:

MANUFACTURER:										
Address:										
NAME:					TYPE:			WEIGHT:		
SPECIFICATION:					DIMENSION:			SERIAL No.:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	9.7	10.7	9.9	10.9	11.0	15.9	16.9	16.2	17.1	17.3
3H	9.5	10.4	9.8	10.6	10.8	15.7	16.7	16.0	16.9	17.1
4H	9.4	10.3	9.7	10.5	10.8	15.7	16.5	15.9	16.8	17.0
6H	9.3	10.1	9.6	10.4	10.7	15.6	16.4	15.9	16.6	16.9
8H	9.3	10.1	9.6	10.3	10.6	15.5	16.3	15.8	16.6	16.8
12H	9.2	10.0	9.6	10.3	10.6	15.5	16.2	15.8	16.5	16.8
4H 2H	9.6	10.5	9.9	10.7	11.0	15.7	16.6	16.0	16.8	17.0
3H	9.4	10.2	9.8	10.5	10.8	15.5	16.2	15.8	16.5	16.8
4H	9.3	10.0	9.7	10.3	10.7	15.4	16.1	15.8	16.4	16.7
6H	9.3	9.9	9.6	10.2	10.6	15.3	15.9	15.7	16.2	16.6
8H	9.2	9.8	9.6	10.1	10.5	15.2	15.8	15.6	16.2	16.5
12H	9.2	9.7	9.6	10.1	10.5	15.2	15.7	15.6	16.1	16.5
8H 4H	9.2	9.8	9.6	10.1	10.5	15.2	15.8	15.6	16.2	16.5
6H	9.1	9.6	9.5	10.0	10.4	15.1	15.6	15.6	16.0	16.4
8H	9.1	9.5	9.5	9.9	10.3	15.1	15.5	15.5	15.9	16.4
12H	9.0	9.4	9.5	9.8	10.3	15.0	15.4	15.5	15.8	16.3
12H 4H	9.2	9.7	9.6	10.0	10.4	15.2	15.7	15.6	16.1	16.5
6H	9.1	9.5	9.5	9.9	10.3	15.1	15.5	15.5	15.9	16.4
8H	9.0	9.4	9.5	9.8	10.3	15.0	15.4	15.5	15.8	16.3
Variations with the observer position at spacings:										
S = 1.0H	+ 3.5 / -13.5					+ 3.0 / - 7.0				
1.5H	+ 3.9 / -13.8					+ 2.7 / - 8.1				
2.0H	+ 5.4 / -12.2					+ 6.2 / -21.1				

CIE Pub.117 Corrected 2494 lm Total Lamp Luminous Flux. (8log(F/F0) = 3.2)

 Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:2026年07月27日

 Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

UTILIZATION FACTORS TABLE

Report number:

MANUFACTURER:										
Address:										
NAME:					TYPE:			WEIGHT:		
SPECIFICATION:					DIMENSION:			SERIAL No.:		

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	80	73	68	80	72	68	79	72	68	64
0.80	89	82	77	88	81	77	87	81	77	72
1.00	95	88	84	94	88	84	92	88	83	79
1.25	100	94	90	99	93	89	96	92	88	84
1.50	103	97	94	102	97	93	99	95	92	87
2.00	107	102	98	105	101	97	102	99	96	90
2.50	109	104	101	107	103	100	104	100	98	91
3.00	110	106	103	108	105	102	105	102	100	93
4.00	113	109	107	110	108	105	107	104	103	95
5.00	114	111	109	112	109	107	107	106	104	96
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004				Suspended				SHRNOM = 1.25		


Test System: HopooColor HPG1800
 Temperature: 25.3 DEG
 Operators:
 Test Date: 2026年07月27日

Test Set: 5.0 deg/s C-Gamma (TYPE C)
 Humidity: 65.0%
 Test Distance: 8.300 m
 Remarks:

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME:	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

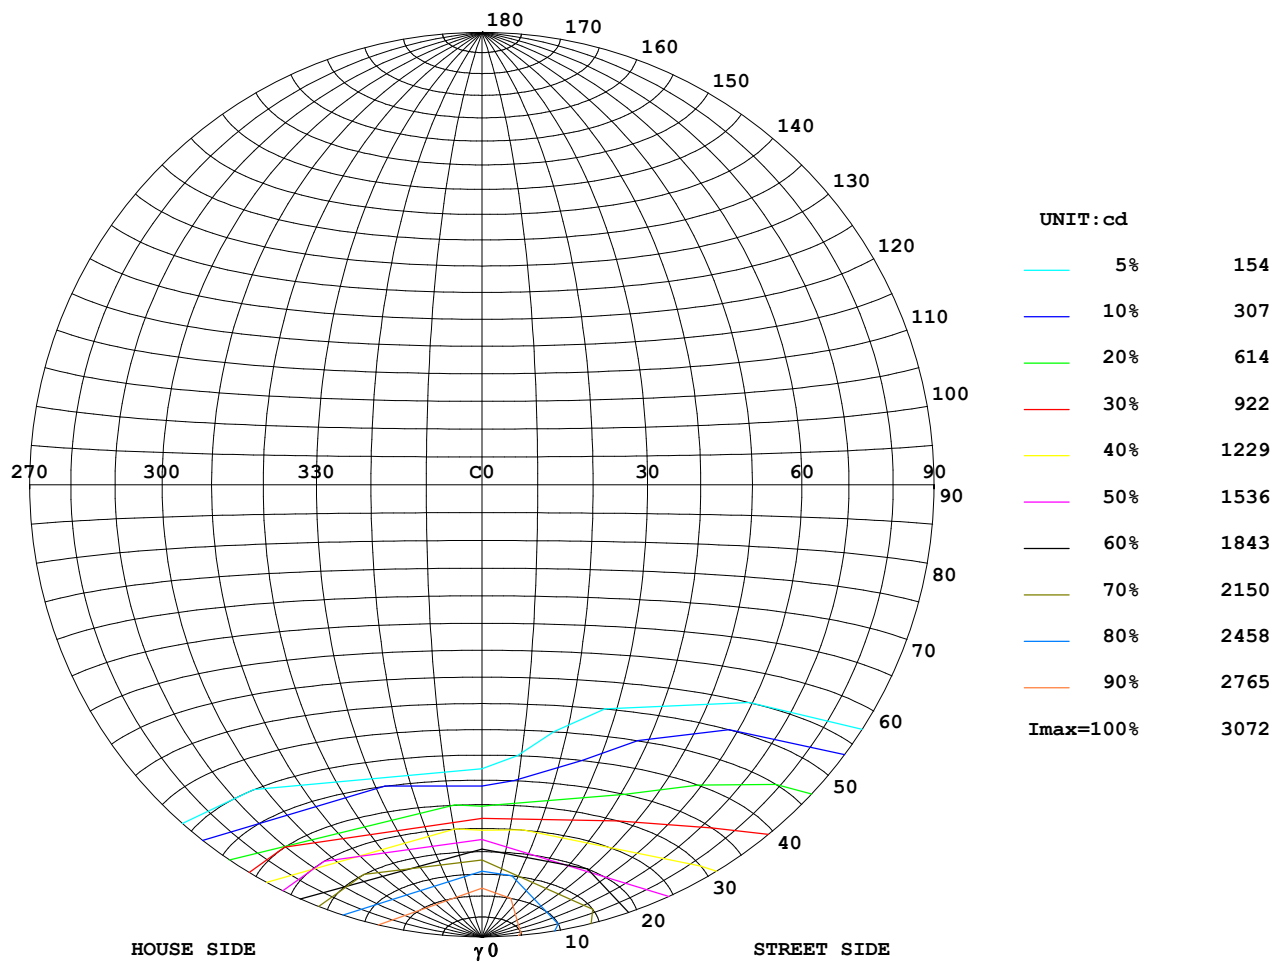

Test System: HopooColor HPG1800
 Temperature: 25.3 DEG
 Operators:
 Test Date: 2026年07月27日



Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity: 65.0%
 Test Distance: 8.300 m
 Remarks:

ISOLUX DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME:	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

ILLUMINANCE AT MH=10 m, Enadir = 30.26 lx

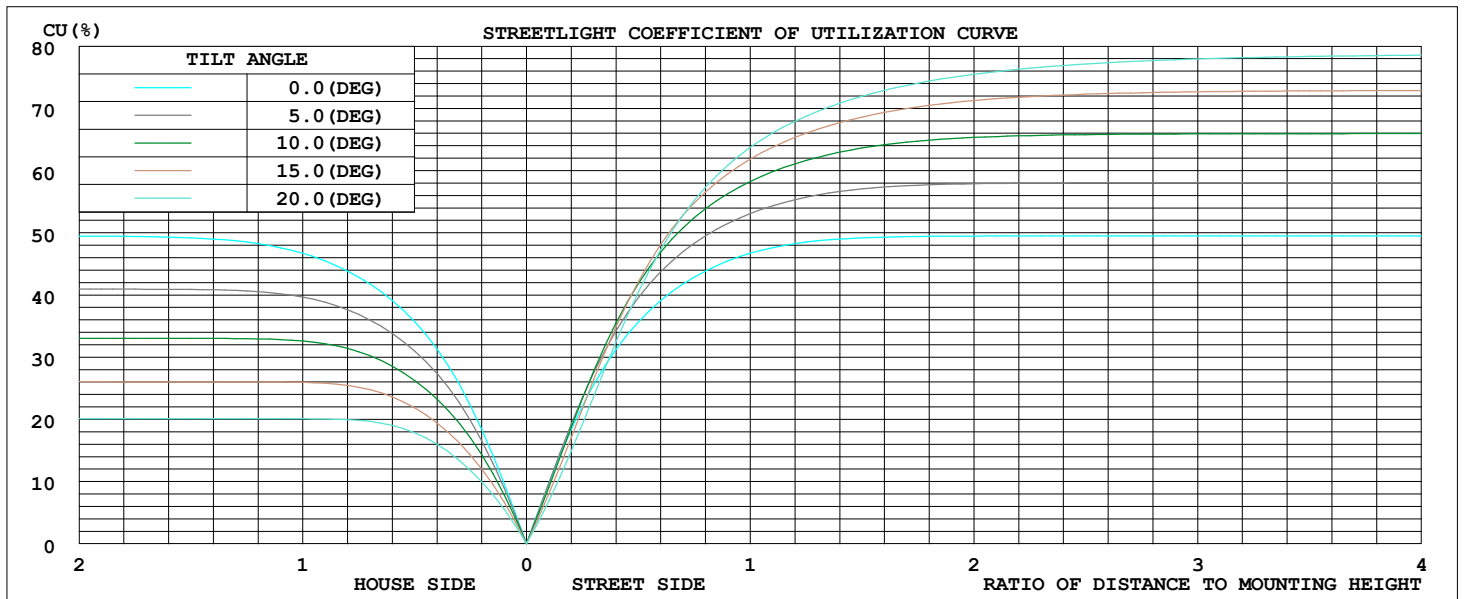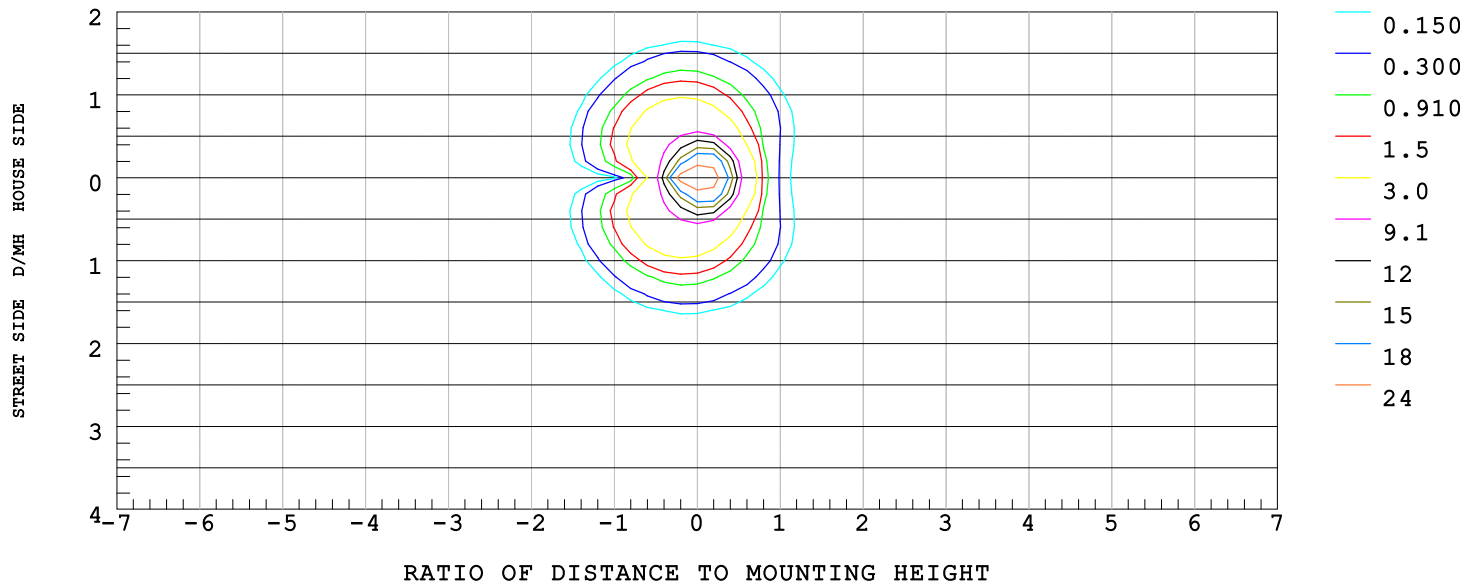


Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:2026年07月27日

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME:	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

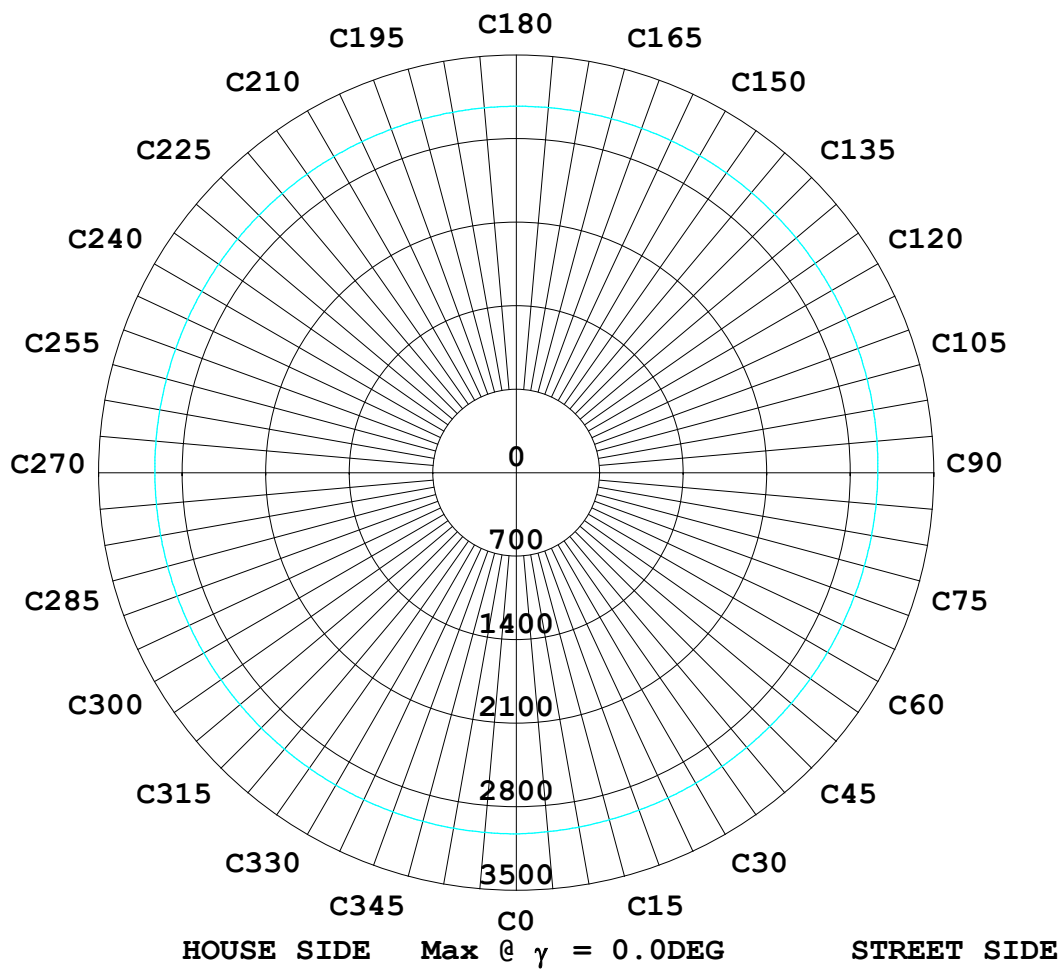

Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:2026年07月27日

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Report number:

MANUFACTURER:		
Address:		
NAME:	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

UNIT: cd

C (DEG)				
γ (DEG)	0	90	180	270
0.0	3026	3030	3072	3030
5.0	3013	2744	3021	2744
10.0	2891	2407	2907	2407
15.0	2542	2084	2686	2084
20.0	1923	1777	2287	1777
25.0	1174	1506	1683	1506
30.0	573	1278	1019	1278
35.0	222	1081	503	1081
40.0	71.0	898	189	898
45.0	26.4	699	68.9	699
50.0	15.2	470	37.2	470
55.0	10.4	228	22.6	228
60.0	6.88	64.4	12.5	64.4
65.0	4.68	5.02	6.68	5.02
70.0	3.44	0.00	4.13	0.00
75.0	2.54	0.00	2.89	0.00
80.0	1.72	0.00	1.92	0.00
85.0	1.24	0.00	1.30	0.00
90.0	0.76	0.00	0.76	0.00
95.0	0.48	0.00	0.55	0.00
100.0	0.34	0.00	0.41	0.00
105.0	0.34	0.00	0.34	0.00
110.0	0.34	0.00	0.28	0.00
115.0	0.55	0.00	0.28	0.00
120.0	1.03	0.00	0.41	0.00
125.0	1.79	0.00	0.96	0.00
130.0	2.75	0.00	1.79	0.00
135.0	3.99	0.96	2.89	0.96
140.0	5.23	2.34	4.20	2.34
145.0	6.54	3.92	5.64	3.92
150.0	7.71	5.71	7.09	5.71
155.0	8.88	7.44	8.40	7.44
160.0	9.98	8.74	9.64	8.74
165.0	10.9	9.57	10.7	9.57
170.0	11.7	10.4	11.7	10.4
175.0	12.1	11.5	12.4	11.5
180.0	11.9	12.4	12.6	12.4

Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:2026年07月27日

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks: