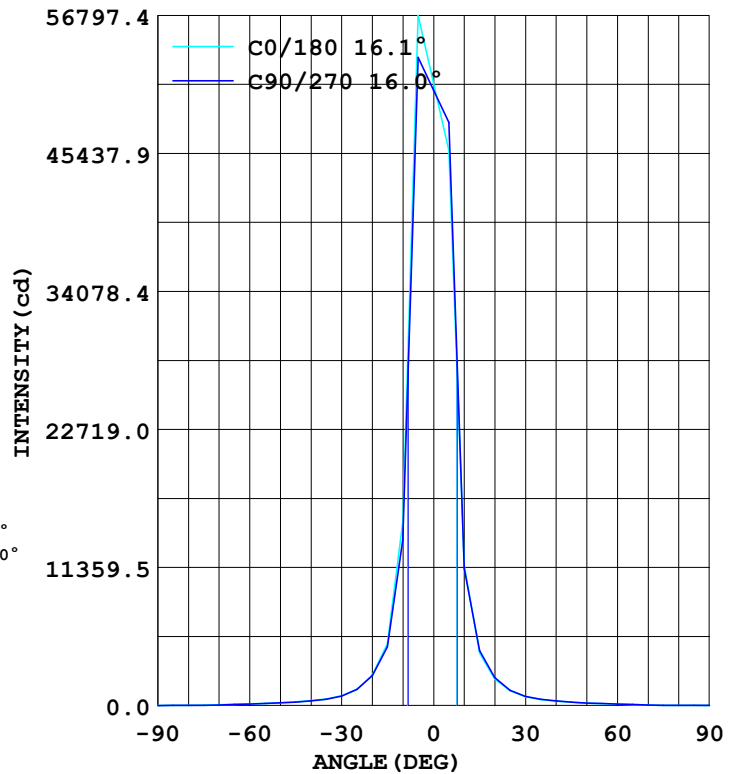
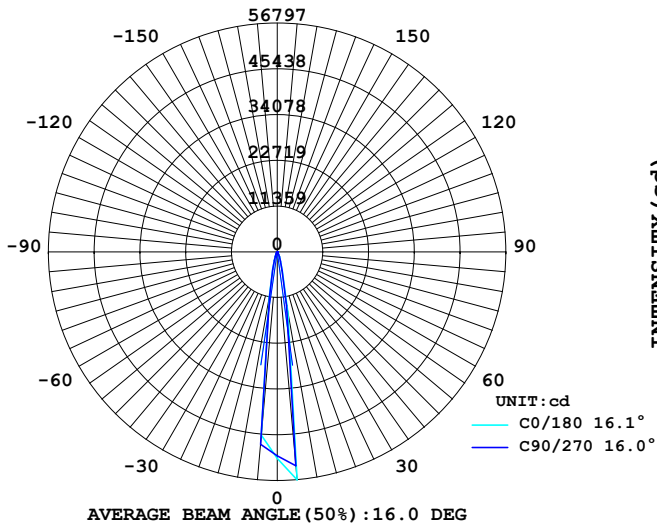


LUMINAIRE PHOTOMETRIC TEST REPORT

Report number:

MANUFACTURER:		
Address:		
NAME: rain7	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

DATA OF LAMP		Imax(cd)	56797	S/MH (C0/180)	0.26
MODEL		EFFICIENCY (%)	100.0	S/MH (C90/270)	0.25
NOMINAL POWER(W)	82	TOTAL FLUX(lm)	6640.1	Voltage(V)	219.6
RATED VOLTAGE (V)	220	EFFICIENCY (lm/W)	81.0	Current(A)	0.389
NOMINAL FLUX(lm)	6640.2	η up (%)	0.7	Power(W)	81.98
LAMPS QUANTITY	1	η down (%)	99.3	Power Factor (PF)	0.959
TEST VOLTAGE (V)	219.6	Effective Flux(lm)	4543.0	EEI	0.000 (E)

LUMINOUS INTENSITY DISTRIBUTION
LUMINOUS INTENSITY DISTRIBUTION


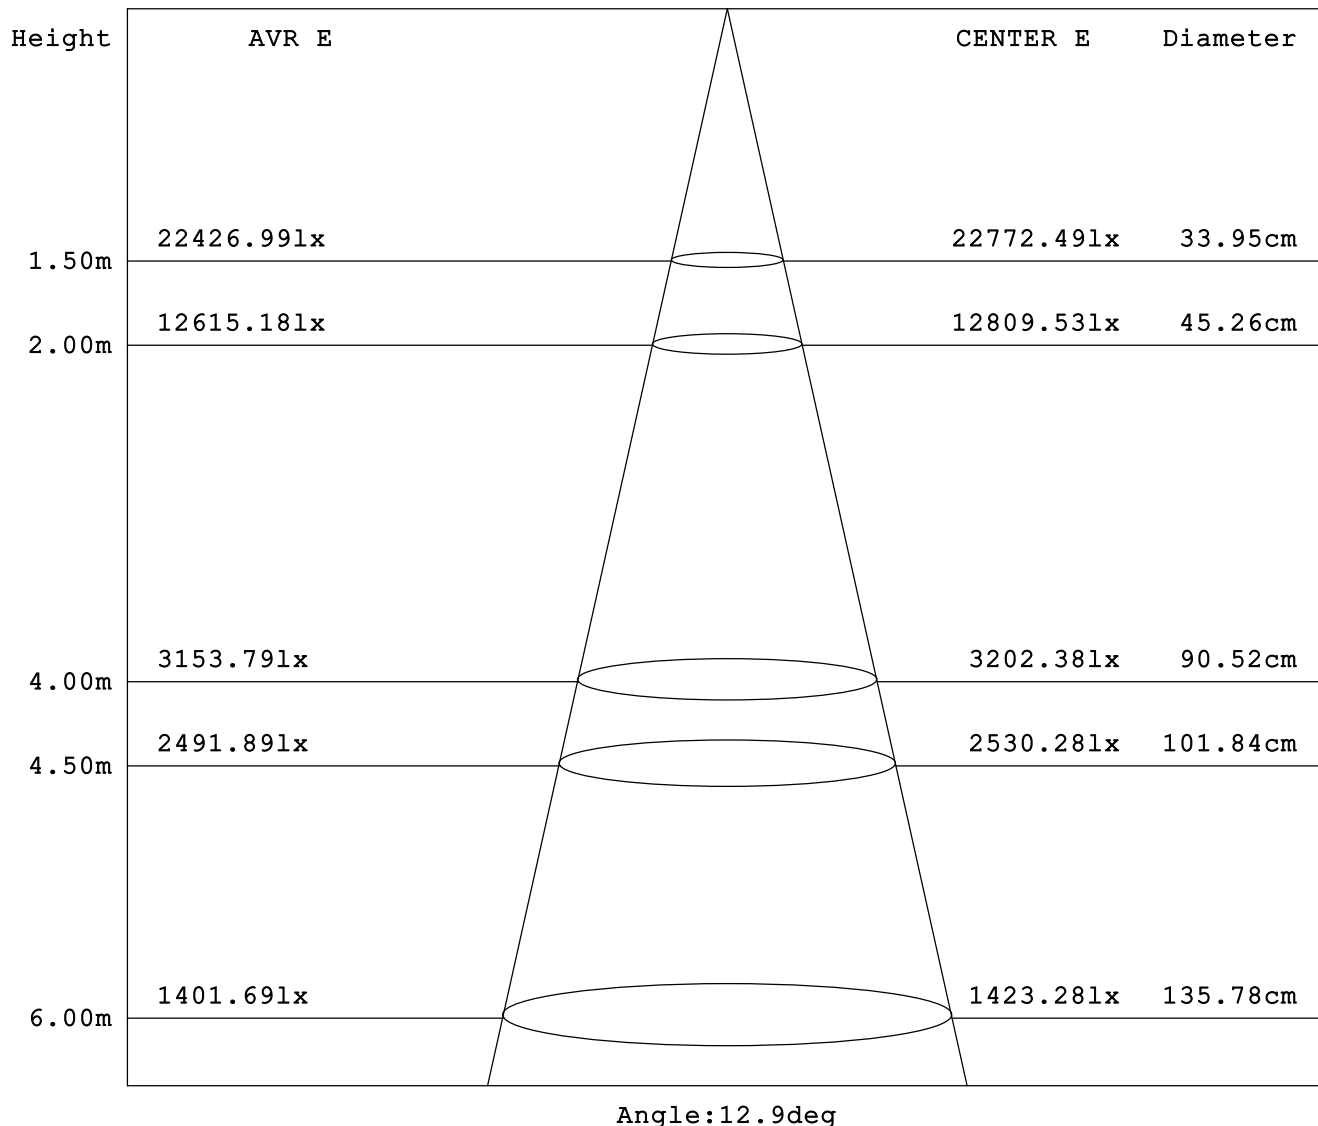
Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:05-20-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:

AVERAGE AND CENTER E Figure

Report number:

MANUFACTURER:		
Address:		
NAME: rain7	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:



Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:05-20-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

ZONAL FLUX DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: rain7	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

γ	C0	C90	C180	C270					γ	Zone	total
10.0	1510	1363	1149	1128					0- 10	3501	3501
20.0	252.1	246.0	221.2	229.7					10- 20	1624	5125
30.0	80.83	78.07	72.04	74.89					20- 30	642.6	5768
40.0	40.50	39.06	36.67	38.17					30- 40	339.2	6107
50.0	22.57	21.51	19.90	21.02					40- 50	224.5	6331
60.0	13.48	12.43	11.31	12.09					50- 60	148.8	6480
70.0	5.614	4.774	4.105	4.691					60- 70	83.80	6564
80.0	1.370	0.937	0.703	1.026					70- 80	27.02	6591
90.0	0.172	0	0	0.158					80- 90	4.284	6595
100.0	0.117	0	0	0.103					90-100	0.733	6596
110.0	0.117	0.014	0.007	0.096					100-110	0.574	6597
120.0	0.145	0.083	0.062	0.117					110-120	0.780	6598
130.0	0.234	0.214	0.152	0.179					120-130	1.260	6599
140.0	0.634	0.634	0.406	0.406					130-140	2.536	6601
150.0	3.010	2.969	1.660	1.701					140-150	7.649	6609
160.0	4.450	4.594	3.788	3.664					150-160	15.56	6625
170.0	4.222	4.498	3.988	4.030					160-170	12.00	6637
180.0	3.044	3.127	3.038	3.155					170-180	3.590	6640
DEG	LUMINOUS INTENSITY:×10cd									UNIT:lm	

Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:05-20-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:


LUMINANCE LIMITATION CURVES

Report number:

MANUFACTURER:		
Address:		
NAME: rain7	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

LUMINANCE LIMITATION CURVES

GLARE	CLASS	ILLUMINANCE (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

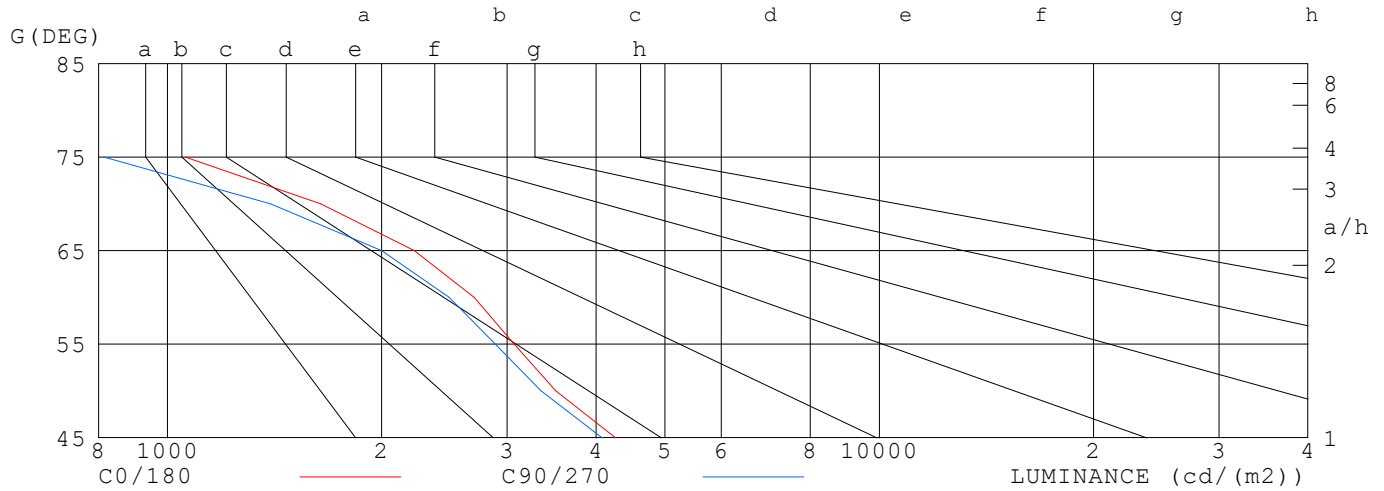

LUMINANCE cd/m2		
G (DEG)	C0/180	C90/270
85	522	166
80	789	540
75	1059	814
70	1642	1396
65	2222	2000
60	2696	2487
55	3069	2887
50	3512	3347
45	4263	4082

Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:05-20-2026


Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: rain7	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

UNIT: cd

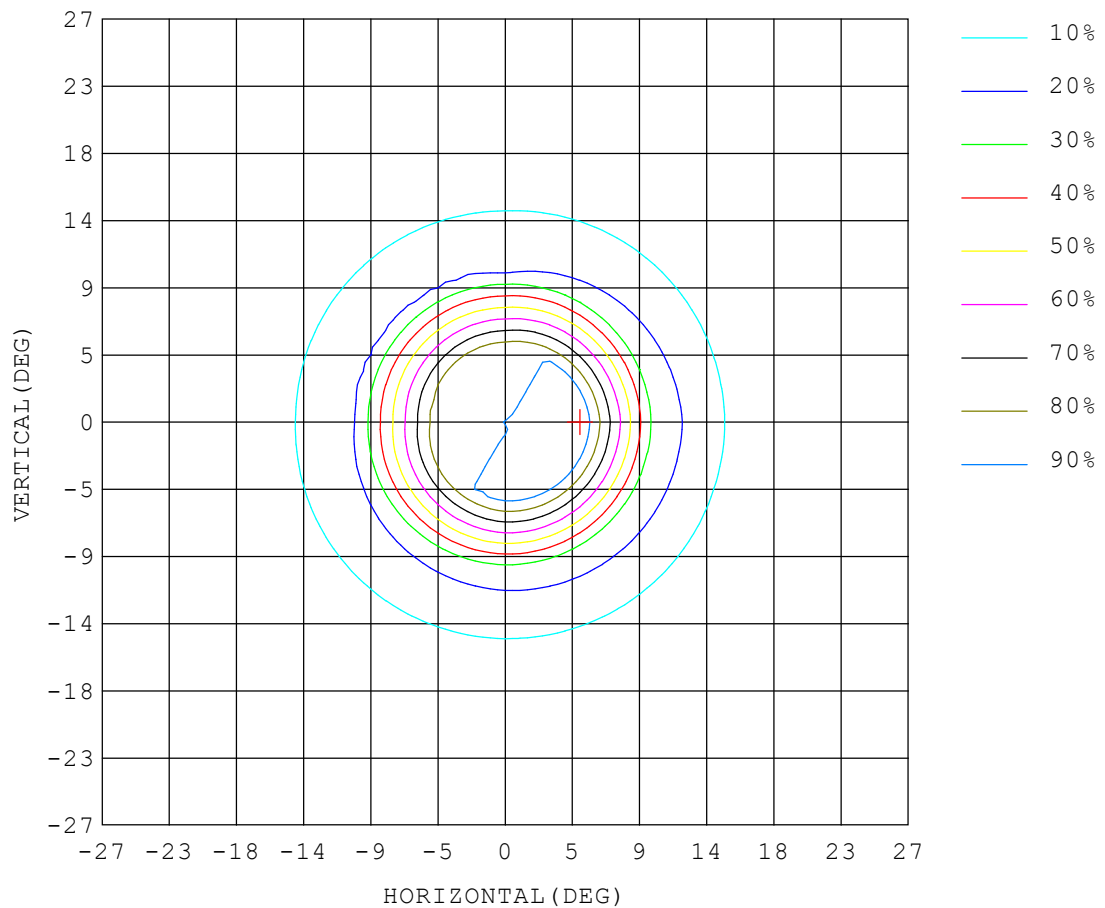


Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:05-20-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:

ISOLUX DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: rain7	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

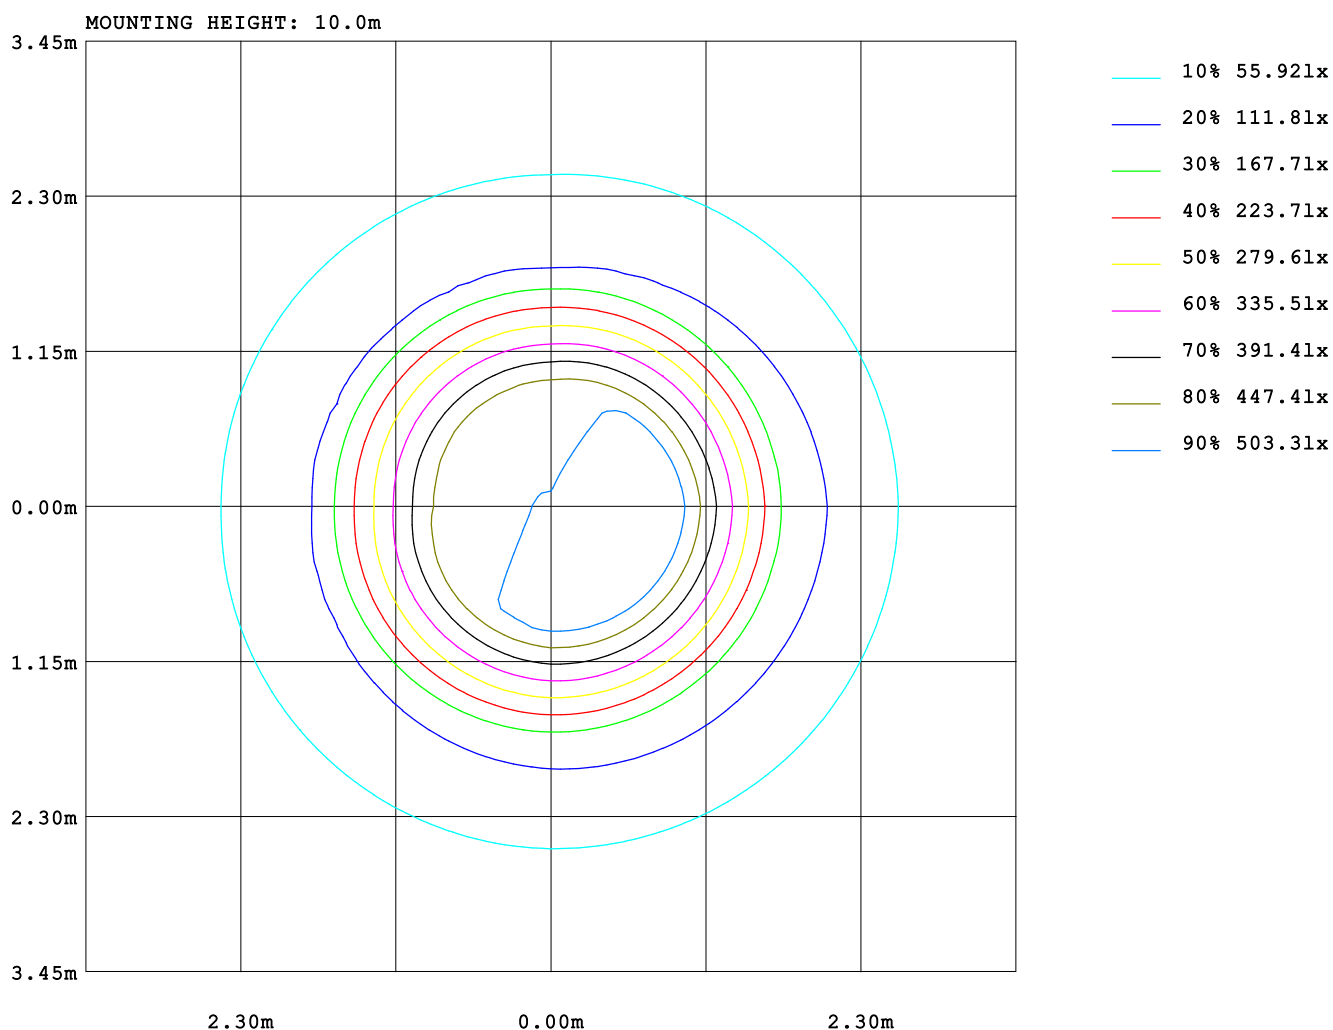

Test System: HopooColor HPG1800
 Temperature: 25.3DEG
 Operators:
 Test Date: 05-20-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity: 65.0%
 Test Distance: 8.300 m
 Remarks:

AREA LUMINOUS FLUX

Report number:

MANUFACTURER:																			
Address:																			
NAME: rain7										TYPE:					WEIGHT:				
SPECIFICATION:										DIMENSION:					SERIAL No.:				

		AREA FLUX DIAGRAM																		UNIT:lm		Φ t	Φ a
VERTICAL (DEG)	27	1.21	1.44	1.69	1.97	2.33	2.68	2.96	3.17	3.30	3.31	3.20	3.01	2.75	2.41	2.05	1.77	1.51	1.27	42.1	0.00		
	24	1.40	1.69	2.05	2.55	3.02	3.55	4.12	4.57	4.81	4.83	4.64	4.21	3.65	3.12	2.66	2.16	1.79	1.49	56.4	0.00		
	21	1.61	2.01	2.58	3.20	4.07	4.97	5.74	6.45	6.92	6.97	6.58	5.92	5.16	4.25	3.34	2.72	2.14	1.72	76.4	0.00		
	18	1.83	2.44	3.14	4.21	5.37	6.78	8.43	9.71	10.4	10.5	9.98	8.80	7.14	5.68	4.46	3.31	2.60	1.97	107	0.00		
	15	2.13	2.85	3.92	5.27	7.16	9.53	11.9	15.2	17.5	17.8	15.9	12.7	10.2	7.71	5.67	4.19	3.03	2.30	155	47.8		
	12	2.42	3.30	4.70	6.54	9.36	13.1	19.9	25.5	30.4	31.3	27.5	22.0	14.5	10.2	7.16	5.11	3.55	2.61	240	163		
	9	2.65	3.78	5.35	8.01	11.6	19.7	30.2	55.1	77.0	79.4	60.3	34.8	22.9	13.0	8.95	5.91	4.11	2.87	446	384		
		2.82	4.14	5.94	9.08	14.6	25.3	54.5	101	126	131	113	64.2	30.9	17.3	10.3	6.67	4.57	3.06	724	666		
		2.92	4.32	6.30	9.62	16.8	30.1	74.4	122	134	141	143	91.3	38.4	20.7	11.1	7.19	4.83	3.19	863	808		
		2.93	4.33	6.32	9.66	17.0	30.6	75.7	125	138	145	146	92.5	38.9	20.9	11.2	7.21	4.84	3.20	879	823		
		2.84	4.18	6.00	9.19	15.0	26.5	57.3	107	136	141	119	67.1	32.1	17.6	10.4	6.73	4.61	3.08	766	707		
	-9	2.68	3.83	5.44	8.16	11.9	21.0	33.1	60.6	85.9	88.4	65.8	37.7	24.2	13.3	9.10	6.00	4.17	2.90	485	421		
	-12	2.46	3.36	4.81	6.71	9.64	13.8	21.8	29.1	35.7	36.5	31.1	23.9	15.1	10.5	7.32	5.22	3.61	2.65	264	191		
	-15	2.17	2.91	4.02	5.43	7.42	9.92	12.6	16.6	19.7	20.0	17.3	13.3	10.5	7.96	5.83	4.30	3.09	2.33	166	62.5		
	-18	1.86	2.50	3.23	4.36	5.58	7.09	8.87	10.2	11.1	11.2	10.5	9.24	7.45	5.89	4.61	3.41	2.65	2.00	112	0.00		
	-21	1.63	2.05	2.66	3.32	4.24	5.21	6.05	6.85	7.39	7.44	6.98	6.23	5.40	4.42	3.46	2.80	2.18	1.75	80.1	0.00		
-24	1.43	1.72	2.11	2.63	3.15	3.73	4.35	4.85	5.13	5.16	4.92	4.44	3.83	3.25	2.74	2.22	1.82	1.51	59.0	0.00			
-27	1.23	1.47	1.73	2.02	2.41	2.80	3.11	3.35	3.52	3.53	3.39	3.17	2.87	2.49	2.11	1.81	1.54	1.29	43.9	0.00			
		-27	-24	-21	-18	-15	-12	-9	-6	HORIZONTAL (DEG)			6	9	12	15	18	21	24	27			
Φ t	38.3	52.3	72.1	102	151	237	436	706	853	885	790	505	277	171	113	78.8	56.7	41.2	6640				
Φ a	0.00	0.00	0.00	0.00	44.4	158	369	644	793	824	729	440	200	72.0	0.00	0.00	0.00	0.00	0.00		4543		

Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:05-20-2026


Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

Report number:

MANUFACTURER:															
Address:															
NAME: rain7								TYPE:				WEIGHT:			
SPECIFICATION:								DIMENSION:				SERIAL No.:			

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Coefficients of Utilization(CU)									
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.01	1.01	1.01	.99
1.0	1.13	1.11	1.09	1.10	1.09	1.07	1.06	1.05	1.04	1.03	1.01	1.01	.99	.98	.98	.96
2.0	1.07	1.04	1.02	1.05	1.03	1.00	1.02	.00	.98	.99	.97	.96	.96	.95	.94	.92
3.0	1.03	.99	.96	1.01	.98	.95	.99	.96	.94	.96	.94	.92	.94	.92	.91	.89
4.0	.99	.95	.92	.98	.94	.91	.95	.92	.90	.94	.91	.89	.92	.90	.88	.87
5.0	.95	.91	.88	.94	.91	.88	.93	.89	.87	.91	.88	.86	.90	.87	.85	.84
6.0	.92	.88	.85	.92	.88	.85	.90	.87	.84	.89	.86	.84	.88	.85	.83	.82
7.0	.90	.86	.83	.89	.85	.83	.88	.85	.82	.87	.84	.82	.86	.83	.81	.80
8.0	.87	.83	.81	.87	.83	.80	.86	.83	.80	.85	.82	.80	.84	.81	.79	.79
9.0	.85	.81	.79	.85	.81	.79	.84	.81	.78	.83	.80	.78	.83	.80	.78	.77
10.0	.83	.80	.77	.83	.79	.77	.82	.79	.77	.82	.79	.77	.81	.78	.76	.76

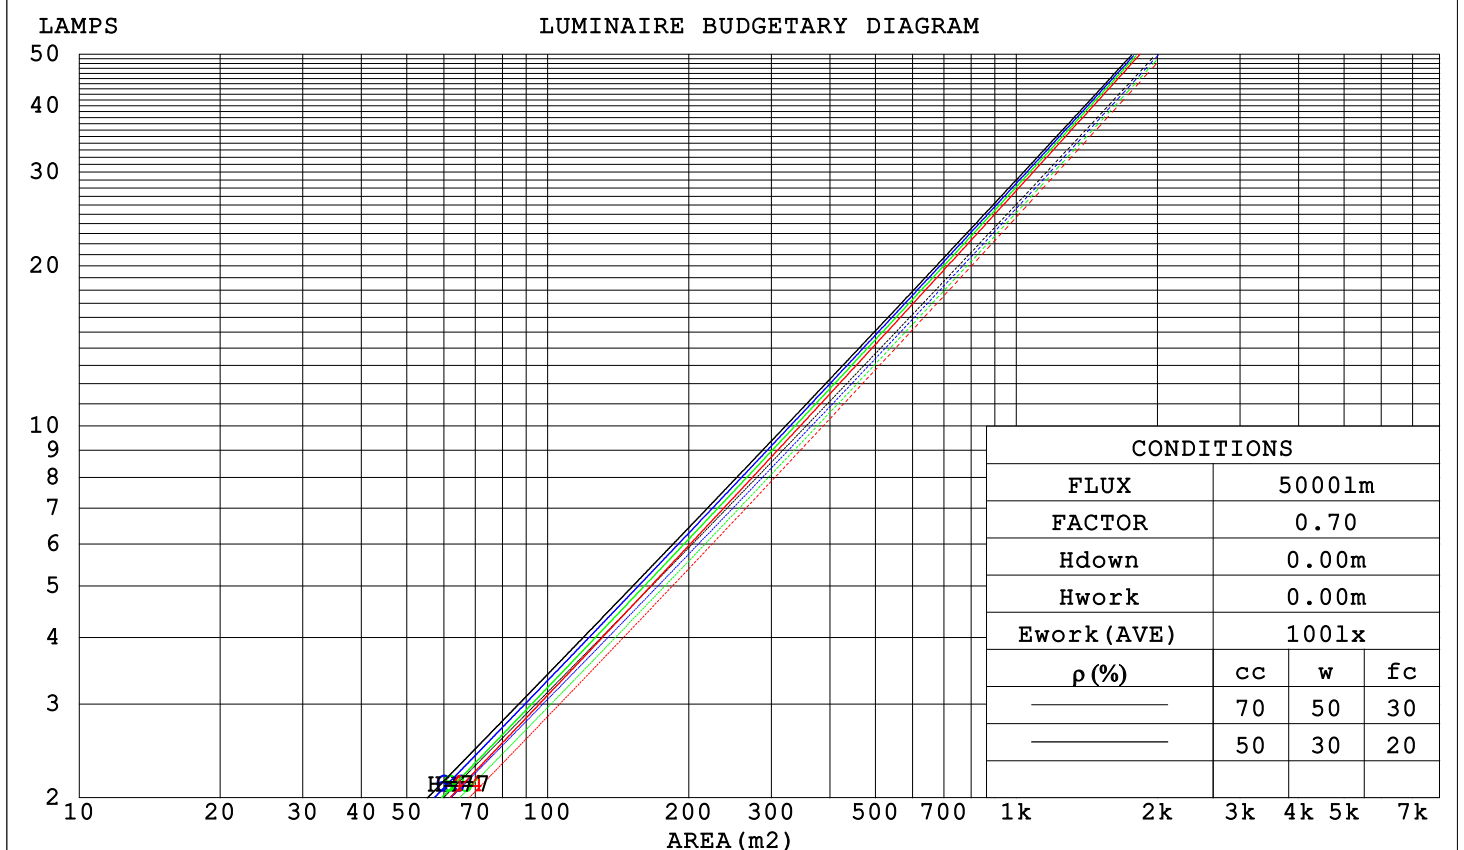
 Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:05-20-2026

 Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

WEC AND CCEC

Report number:

MANUFACTURER:															
Address:															
NAME: rain7								TYPE:				WEIGHT:			
SPECIFICATION:								DIMENSION:				SERIAL No.:			

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients (WEC)									
0.0																
1.0	.140	.079	.025	.133	.076	.024	.120	.069	.022	.108	.063	.020	.098	.057	.018	
2.0	.130	.071	.022	.124	.068	.021	.114	.063	.020	.104	.058	.018	.095	.054	.017	
3.0	.120	.064	.019	.116	.062	.019	.107	.058	.018	.099	.054	.017	.091	.050	.016	
4.0	.112	.058	.017	.108	.056	.017	.100	.053	.016	.093	.050	.015	.087	.047	.014	
5.0	.104	.053	.015	.101	.052	.015	.095	.049	.014	.089	.047	.014	.083	.044	.013	
6.0	.098	.049	.014	.095	.048	.014	.089	.046	.013	.084	.044	.013	.079	.042	.012	
7.0	.092	.045	.013	.089	.045	.013	.085	.043	.012	.080	.041	.012	.076	.039	.012	
8.0	.087	.042	.012	.085	.042	.012	.080	.040	.011	.076	.039	.011	.073	.037	.011	
9.0	.082	.040	.011	.080	.039	.011	.076	.038	.011	.073	.037	.010	.070	.035	.010	
10.0	.078	.037	.010	.076	.037	.010	.073	.036	.010	.070	.035	.010	.067	.034	.010	

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients (CCEC)									
0.0	.196	.196	.196	.167	.167	.167	.114	.114	.114	.066	.066	.066	.021	.021	.021	
1.0	.174	.163	.153	.149	.140	.132	.102	.096	.091	.059	.056	.053	.019	.018	.017	
2.0	.156	.138	.123	.133	.119	.106	.091	.082	.074	.053	.048	.043	.017	.015	.014	
3.0	.141	.119	.101	.121	.102	.087	.083	.071	.061	.048	.041	.036	.015	.013	.012	
4.0	.128	.103	.084	.110	.089	.073	.076	.062	.051	.044	.036	.030	.014	.012	.010	
5.0	.118	.091	.071	.101	.079	.062	.070	.055	.044	.040	.032	.026	.013	.011	.009	
6.0	.108	.081	.061	.093	.070	.053	.064	.049	.038	.037	.029	.022	.012	.009	.007	
7.0	.100	.073	.053	.086	.063	.046	.060	.044	.033	.035	.026	.020	.011	.009	.006	
8.0	.093	.066	.047	.080	.057	.041	.056	.040	.029	.032	.024	.017	.010	.008	.006	
9.0	.087	.060	.041	.075	.052	.036	.052	.037	.026	.030	.022	.015	.010	.007	.005	
10.0	.082	.055	.037	.071	.048	.032	.049	.034	.023	.029	.020	.014	.009	.007	.005	

Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:05-20-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks:

Uncorrected UGR Table

Report number:

MANUFACTURER:										
Address:										
NAME: rain7					TYPE:			WEIGHT:		
SPECIFICATION:					DIMENSION:			SERIAL No.:		
ceiling/cavity	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
x = 2H y = 2H	10.6	11.3	10.8	11.4	11.6	10.4	11.0	10.6	11.2	11.4
3H	11.2	11.8	11.4	12.0	12.2	10.8	11.4	11.1	11.6	11.8
4H	11.2	11.8	11.5	12.0	12.2	10.9	11.4	11.1	11.7	11.9
6H	11.2	11.8	11.5	12.0	12.3	10.8	11.4	11.1	11.6	11.9
8H	11.2	11.7	11.5	12.0	12.2	10.8	11.3	11.1	11.6	11.8
12H	11.2	11.7	11.5	11.9	12.2	10.7	11.3	11.1	11.5	11.8
4H 2H	10.9	11.5	11.2	11.7	11.9	10.7	11.3	11.0	11.5	11.7
3H	11.5	12.0	11.8	12.3	12.6	11.2	11.7	11.5	12.0	12.3
4H	11.6	12.1	11.9	12.4	12.7	11.3	11.7	11.6	12.0	12.3
6H	11.6	12.0	12.0	12.4	12.7	11.2	11.7	11.6	12.0	12.3
8H	11.6	12.0	12.0	12.3	12.7	11.2	11.6	11.6	11.9	12.3
12H	11.5	11.9	12.0	12.3	12.7	11.1	11.5	11.5	11.9	12.3
8H 4H	11.5	11.9	11.9	12.3	12.7	11.2	11.6	11.6	12.0	12.3
6H	11.6	11.9	12.0	12.3	12.7	11.2	11.5	11.6	11.9	12.3
8H	11.5	11.8	12.0	12.2	12.7	11.1	11.4	11.6	11.9	12.3
12H	11.5	11.7	12.0	12.2	12.7	11.1	11.3	11.6	11.8	12.3
12H 4H	11.5	11.8	11.9	12.2	12.6	11.2	11.5	11.6	11.9	12.3
6H	11.5	11.8	12.0	12.2	12.7	11.1	11.4	11.6	11.9	12.3
8H	11.5	11.7	12.0	12.2	12.7	11.1	11.3	11.6	11.8	12.3
Variations with the observer position at spacings:										
S = 1.0H	+ 0.6 / - 0.7					+ 0.6 / - 0.8				
1.5H	+ 0.8 / - 0.6					+ 0.8 / - 0.7				
2.0H	+ 1.1 / - 0.9					+ 1.0 / - 1.0				

CIE Pub.117 Corrected 6640 lm Total Lamp Luminous Flux. (8log(F/F0) = 6.6)

 Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:05-20-2026

 Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

UTILIZATION FACTORS TABLE

Report number:

MANUFACTURER:										
Address:										
NAME: rain7					TYPE:			WEIGHT:		
SPECIFICATION:					DIMENSION:			SERIAL No.:		

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	87	80	76	86	80	76	85	79	76	72
0.80	94	88	84	93	88	84	92	87	84	80
1.00	98	93	89	98	92	89	96	92	88	84
1.25	102	97	94	101	97	93	99	95	92	88
1.50	105	100	97	104	100	96	102	98	95	91
2.00	108	104	100	107	103	100	104	101	98	93
2.50	110	106	103	108	105	102	105	102	100	94
3.00	111	108	105	109	106	104	106	104	102	95
4.00	113	111	108	111	109	107	108	106	104	97
5.00	115	112	111	113	111	109	108	107	106	98
ROOM INDEX	UF(total)									Direct
According to DIN EN 13032-2 2004					Suspended			SHRNOM = 1.25		


Test System: HopooColor HPG1800
 Temperature: 25.3DEG
 Operators:
 Test Date: 05-20-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity: 65.0%
 Test Distance: 8.300 m
 Remarks:

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: rain7	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

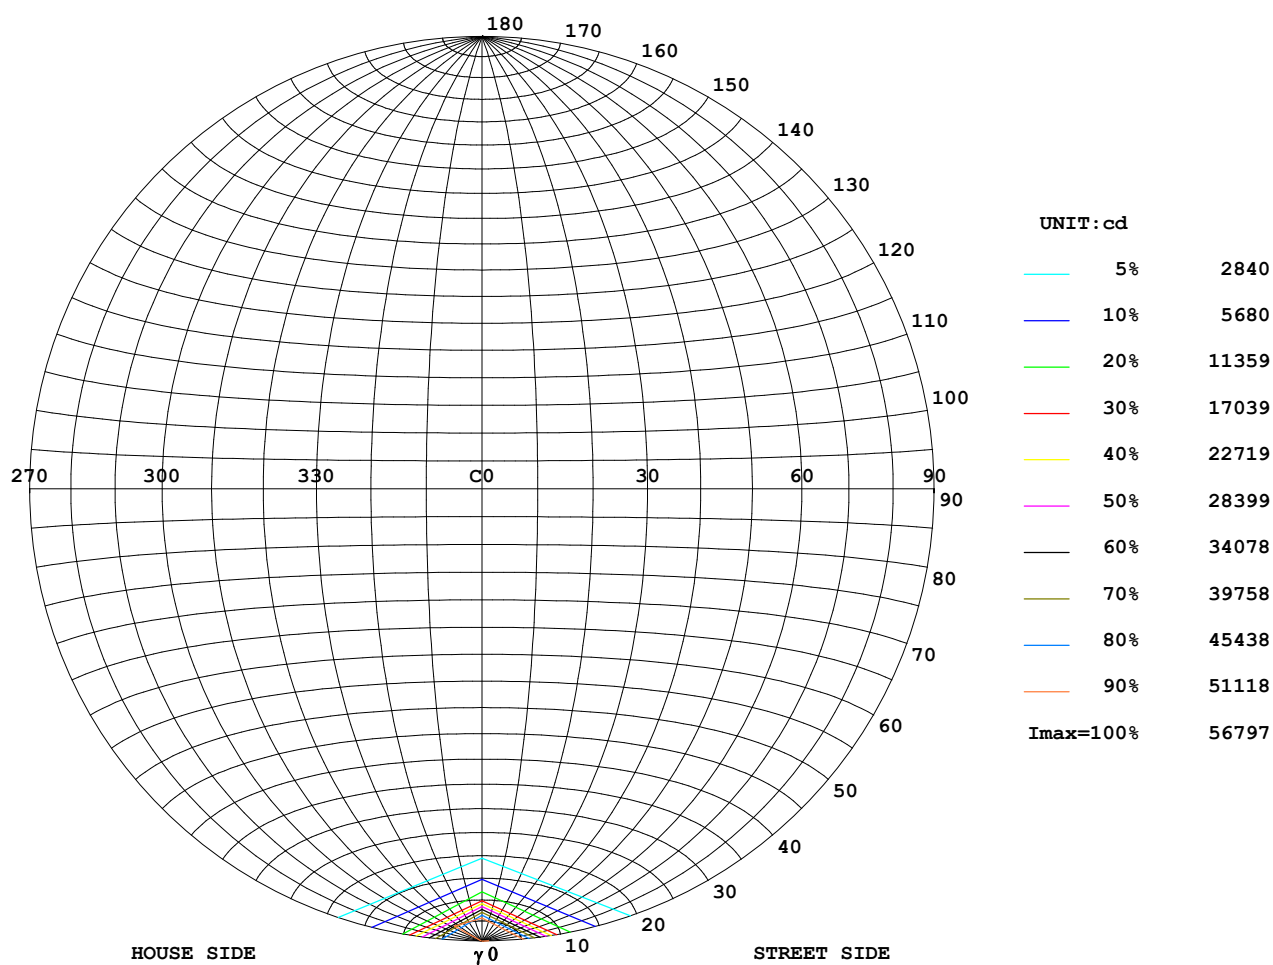

Test System: HopooColor HPG1800
 Temperature: 25.3 DEG
 Operators:
 Test Date: 05-20-2026


Test Set: 5.0 deg/s C-Gamma (TYPE C)
 Humidity: 65.0%
 Test Distance: 8.300 m
 Remarks:

ISOLUX DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: rain7	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

ILLUMINANCE AT MH=10 m, Enadir = 512.38 lx

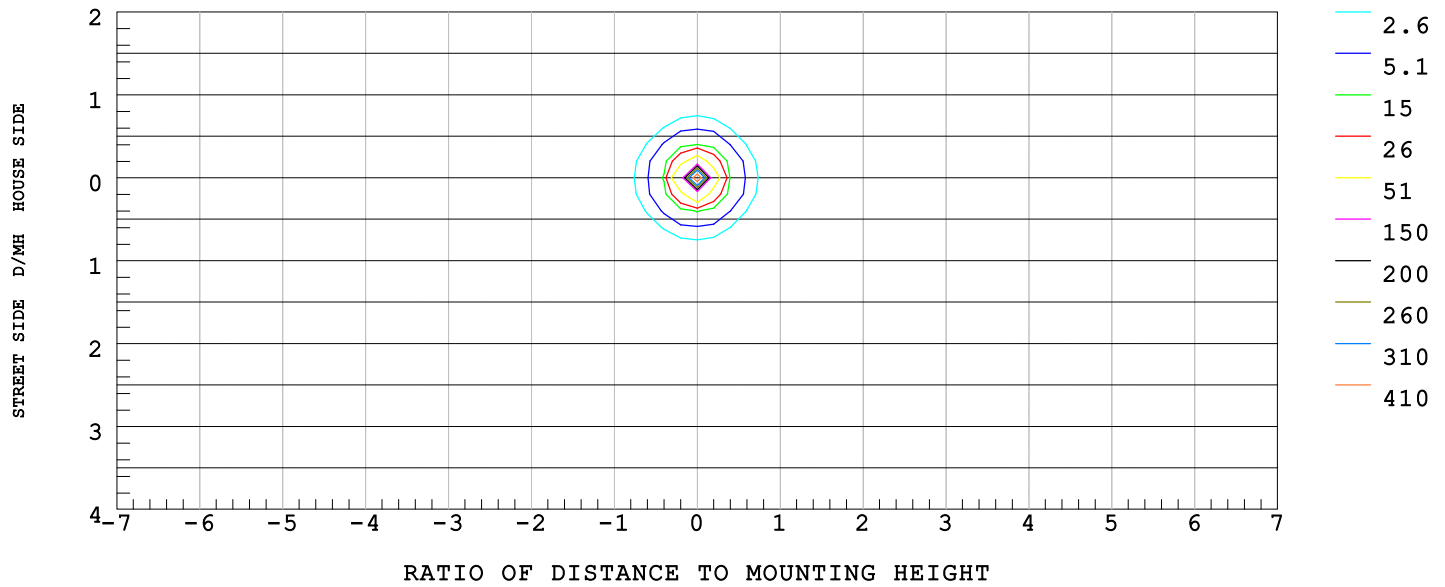

 Test System:HopooColor HPG1800
 Temperature:25.3DEG
 Operators:
 Test Date:05-20-2026

 Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity:65.0%
 Test Distance:8.300 m
 Remarks:

ISOCANDELA DIAGRAM

Report number:

MANUFACTURER:		
Address:		
NAME: rain7	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

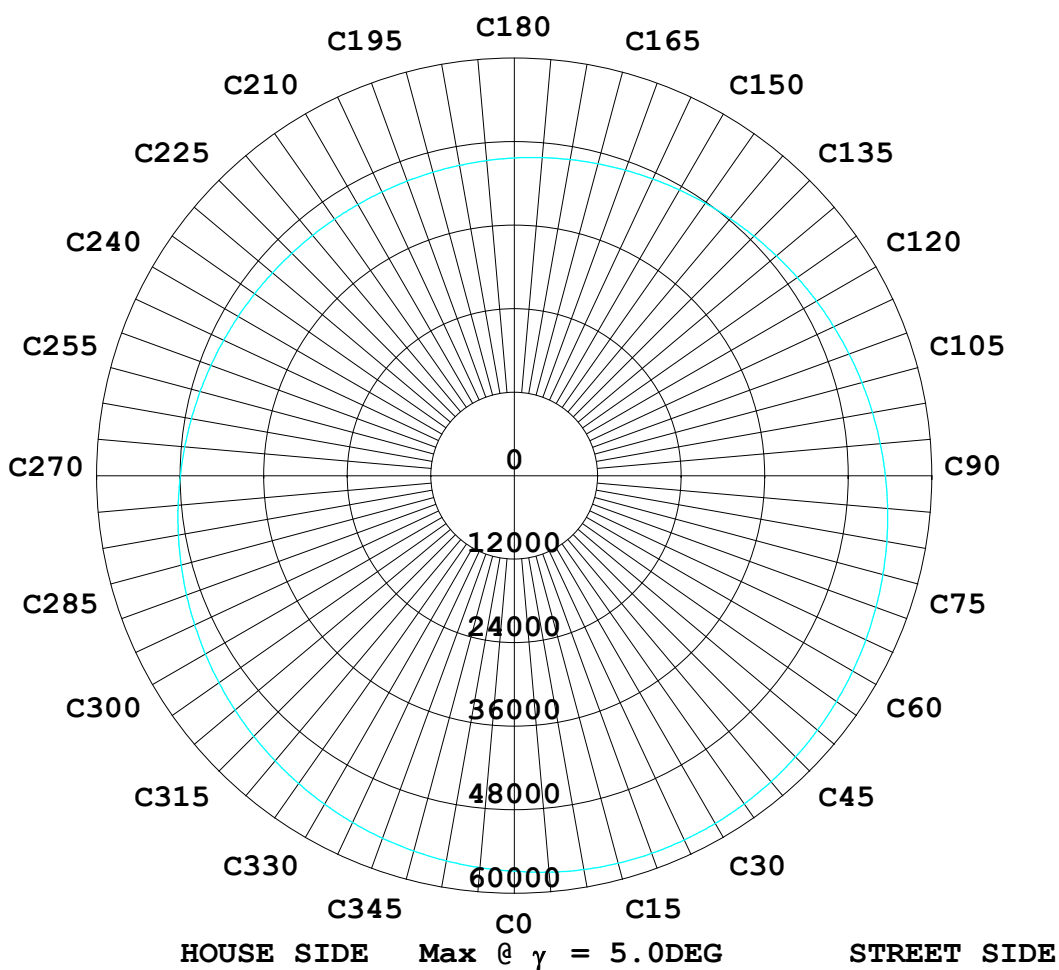

Test System: HopooColor HPG1800
 Temperature: 25.3DEG
 Operators:
 Test Date: 05-20-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
 Humidity: 65.0%
 Test Distance: 8.300 m
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

Report number:

MANUFACTURER:		
Address:		
NAME: rain7	TYPE:	WEIGHT:
SPECIFICATION:	DIMENSION:	SERIAL No.:

UNIT: ×10cd

C (DEG) γ (DEG)	0	90	180	270
0.0	5124	5065	5124	5065
5.0	5680	5332	4568	4798
10.0	1510	1363	1149	1128
15.0	509	483	432	451
20.0	252	246	221	230
25.0	133	133	122	125
30.0	80.8	78.0	72.0	74.8
35.0	53.9	52.6	49.1	50.8
40.0	40.5	39.0	36.6	38.1
45.0	30.1	28.8	26.9	27.8
50.0	22.5	21.5	19.9	21.0
55.0	17.6	16.5	15.5	16.4
60.0	13.4	12.4	11.3	12.0
65.0	9.38	8.45	7.57	8.17
70.0	5.61	4.77	4.10	4.69
75.0	2.74	2.10	1.79	2.26
80.0	1.37	0.94	0.70	1.02
85.0	0.45	0.14	0.05	0.32
90.0	0.17	0.00	0.00	0.16
95.0	0.14	0.00	0.00	0.12
100.0	0.12	0.00	0.00	0.10
105.0	0.11	0.00	0.00	0.10
110.0	0.12	0.01	0.01	0.10
115.0	0.13	0.05	0.03	0.10
120.0	0.14	0.08	0.06	0.12
125.0	0.17	0.13	0.10	0.14
130.0	0.23	0.21	0.15	0.18
135.0	0.37	0.36	0.24	0.25
140.0	0.63	0.63	0.41	0.41
145.0	1.37	1.37	0.76	0.76
150.0	3.01	2.96	1.66	1.70
155.0	4.18	4.23	2.95	2.94
160.0	4.45	4.59	3.78	3.66
165.0	4.47	4.66	4.12	4.00
170.0	4.22	4.49	3.98	4.03
175.0	3.60	3.86	3.41	3.56
180.0	3.04	3.12	3.03	3.15

Test System:HopooColor HPG1800
Temperature:25.3DEG
Operators:
Test Date:05-20-2026

Test Set: 5.0deg/s C-Gamma (TYPE C)
Humidity:65.0%
Test Distance:8.300 m
Remarks: